



SAN ILDEFONSO ROAD 8" WATERLINE REPLACEMENT
IFB-26-23
LOS ALAMOS COUNTY - NEW MEXICO

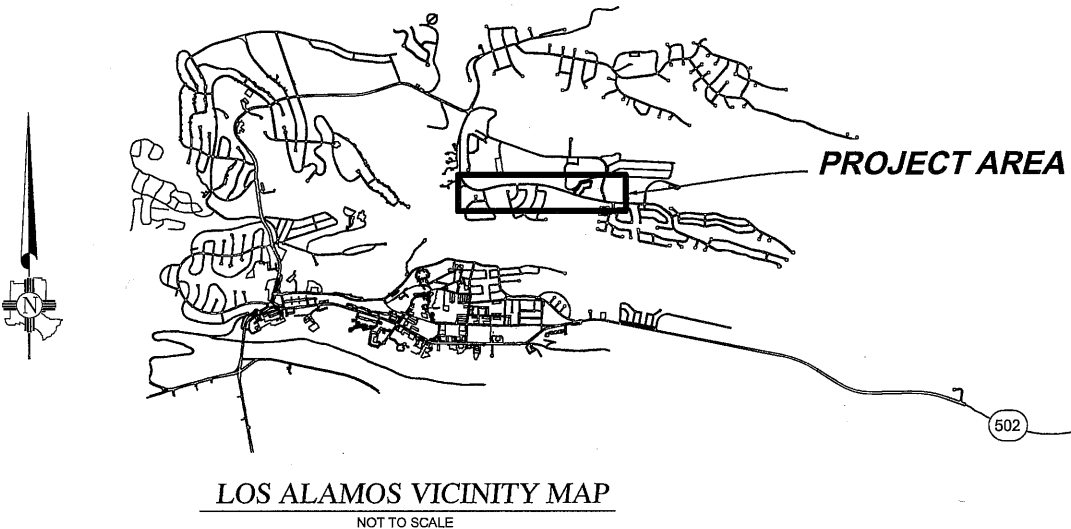


LOS ALAMOS

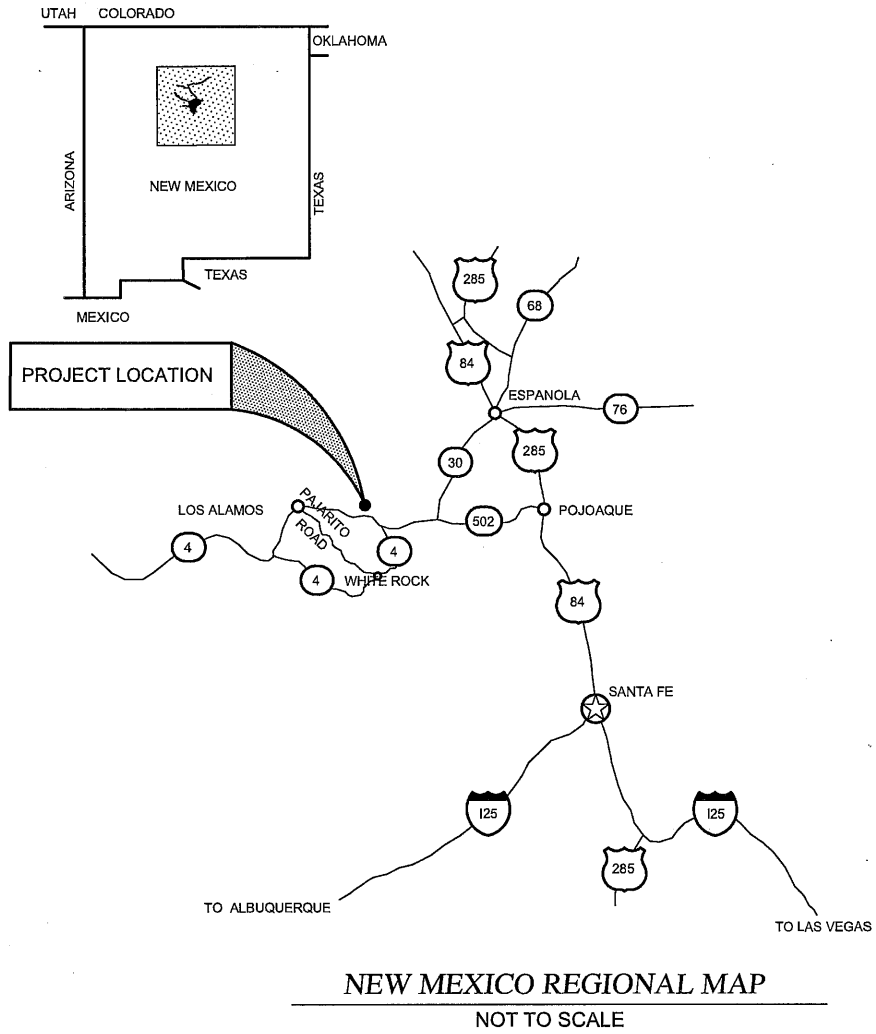

SHEET INDEX

	TITLE SHEET
1	CONSTRUCTION NOTES SHEET
2	PROJECT OVERVIEW
3-13	NEW WATER DISTRIBUTION ALIGNMENT
14-16	STANDARDS SHEETS
17	PRV REHAB DETAILS

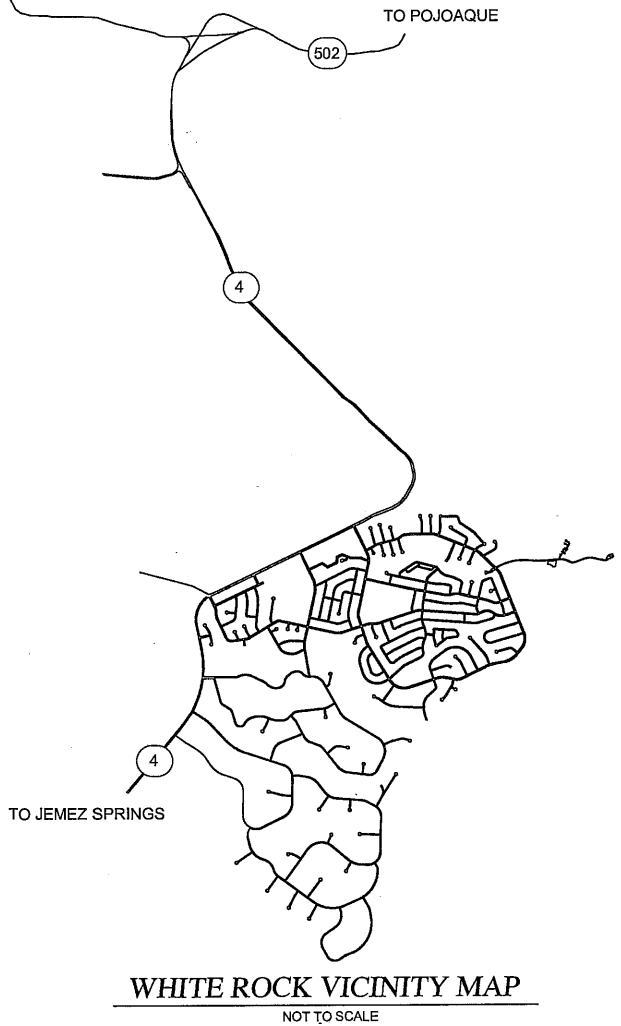

APPROVED BY:  DATE 8/12/2025
DEPARTMENT OF PUBLIC UTILITIES PROJECT ENGINEER

DEPARTMENT OF PUBLIC UTILITIES ENGINEERING ASSOCIATE
DATE



Drawing File: L:\PROJECTS\IFB 2025\XX-SAN ILDEFONSO WATER LINE\03-DESIGN\CAD-DWG\COVER & TITLE SHEET.DWG

DEPARTMENT OF PUBLIC UTILITIES CONSTRUCTION NOTES

GENERAL


- 1. DEPTH OF TRENCH MAY BE DEEPER ALONG CERTAIN SEGMENTS OF PIPELINE TO CLEAR EXISTING UTILITIES AND TO AVOID THE CREATION OF HIGH POINTS ALONG THE ALIGNMENT. NO ADDITIONAL PAYMENT WILL BE MADE FOR INSTALLING PIPE DEEPER THAN MINIMUM REQUIRED DEPTH.
- 2. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR JOB SITE SAFETY, AND FOR KNOWLEDGE AND COMPLIANCE WITH OSHA STANDARDS. THE CONTRACTOR SHALL MAINTAIN ALL TRENCHES IN A SAFE CONDITION PROTECTING THE WORKERS AND THE GENERAL PUBLIC. TRENCH PROTECTION SHALL BE IN ACCORDANCE WITH APPLICABLE OSHA REGULATIONS. EXCAVATION SHALL BE SLOPED, BRACED, OR SHORT AS REQUIRED BY OSHA REGULATIONS. THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR THE SAFE HANDLING OF CONSTRUCTION EQUIPMENT AND MATERIALS TO AND FROM THE STAGING/STORAGE AREA AND FOR SITE SECURITY. THIS WORK SHALL BE CONSIDERED INCIDENTAL TO THE CONSTRUCTION AND NO ADDITIONAL COMPENSATION SHALL BE MADE THEREFOR
- 3. ALL WATER, WASTEWATER, GAS AND ELECTRIC UTILITY INSTALLATIONS, RE-CONSTRUCTION OR REPAIR SHALL COMPLY WITH LOS ALAMOS COUNTY DEPARTMENT OF PUBLIC UTILITIES (DPU) CONSTRUCTION STANDARDS AND THE RELEVANT STANDARD DRAWINGS.
- 4. SUBMITTALS FOR ALL GAS, WATER, SEWER, ELECTRIC AND COUNTY OWNED COMMUNICATION INFRASTRUCTURE SHALL BE SUBMITTED TO THE DPU PROJECT MANAGER FOR REVIEW AND APPROVAL PER THE DPU STANDARD SPECIFICATIONS. SUBMITTALS SHALL INCLUDE THE COVER SHEET IN THE DPU CONSTRUCTION STANDARDS.
- 5. THE CONTRACTOR SHALL RETAIN THE SERVICES OF A NEW MEXICO LICENSED PROFESSIONAL SURVEYOR (NMPS), FOR CONSTRUCTION STAKING, AS WELL AS VERIFICATION OF ALL CRITICAL HORIZONTAL AND VERTICAL CONTROL DATA SHOWN ON THESE CONTRACT DRAWINGS. CONTRACTOR SHALL PROVIDE COORDINATE INFORMATION FOR ALL NEW SAS MANHOLES, WATER AND GAS VALVES, ALL BASED ON STATE PLANE COORDINATES.
- 6. FOR ANY WORK INVOLVING NEW WATER, GAS OR SEWER PIPELINE CONNECTING TO AN EXISTING PIPELINE, CONTRACTOR SHALL OBTAIN A PENETRATION PERMIT FROM THE COUNTY, AT LEAST 48 HOURS IN ADVANCE OF ANY SUCH WORK. THE PERMIT APPLICATION FORM FOR THIS PERMIT CAN BE FOUND AT:

<https://www.losalamosnm.us/Permitting-Information/Add-or-Modify-Utility-Services>

- 7. CONTRACTOR SHALL BE RESPONSIBLE FOR POTHOLING, TO DETERMINE THE EXACT LOCATION OF EXISTING UTILITIES, PRIOR TO PERFORMING ANY EXCAVATION WORK.
- 8. PRIOR TO CONNECTING NEW WATER LINES INTO THE EXISTING SYSTEMS THE LOCATE WIRE SHALL BE TESTED AS FOLLOWS. CONTRACTOR WILL ENSURE THAT ALL LOCATE WIRE HAS BEEN INSTALLED AND MADE ACCESSIBLE IN ALL REQUIRED LOCATIONS. CONTRACTOR WILL VERIFY CONTINUITY IN THE LOCATE WIRE WITH THEIR OWN LOCATE EQUIPMENT. THE LOCATED LOCATION WILL BE PAINTED WITH WHITE PAINT AND DPU STAFF WILL THEN VERIFY THE LOCATION AND CONTINUITY OF THE LOCATE WIRE WITH THEIR OWN EQUIPMENT. ANY AREAS WHERE CONTINUITY IS LOST MUST BE REPAIRED AND RE-VERIFIED BY DPU STAFF TO BE LOCATEABLE. CONTRACTOR SHALL COORDINATE THE LOCATE WIRE VERIFICATION WITH DPU PROJECT MANAGER.
- 9. INFORMATION SPECIFICALLY STATED IN THE CONTRACT DRAWINGS, OR WHEN THE DPU PROJECT MANAGER SPECIFICALLY IDENTIFIES IN THE FIELD, CRITICAL DATA (X, Y, AND Z) RELATED TO WATER VALVES OF ALL KINDS, WATER METERS, FIRE HYDRANTS, CULVERT INLET OR OUTLET INVERTS, WASTEWATER COLLECTION MANHOLE INVERTS AND RIMS, CUSTOMER END OF WASTEWATER SERVICE CONNECTION PIPES/CLEANOUT, SHALL BE COLLECTED BY THE CONTRACTOR'S SURVEYOR FOR THE RECORD DRAWINGS TO BE COMPLETE.
- 10. CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR THE PROTECTION OF SURVEY MONUMENTS OR MARKS. IF CONTRACTOR'S ACTIVITIES CAUSED DAMAGE TO ANY OF THESE MARKS, CONTRACTOR SHALL RETAIN, AT THEIR OWN EXPENSE, THE SERVICES OF A NMLPS, TO RE-ESTABLISH THE MARKS IN COMPLIANCE WITH STANDARDS AND PROCEDURES SET FORTH BY THE "GEODETIC MARK PRESERVATION GUIDEBOOK".
- 11. CONTRACTOR SHALL COMPLY WITH ALL PROVISIONS OF THE CLEAN WATER ACT, RELATED TO STORM WATERS. CONTRACTOR SHALL PREPARE, EXECUTE AND MAINTAIN A STORM WATER POLLUTION PREVENTION PLAN (SWPPP), IF THE AREA DISTURBED BY THE CONSTRUCTION OPERATIONS IS ONE ACRE OR MORE IN SIZE. COSTS ASSOCIATED WITH CLEAN WATER ACT COMPLIANCE, INCLUDING BMP'S, SHALL BE INCIDENTAL TO THE PROJECT'S COST.
- 12. CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR THE COSTS OF REPAIRING ANY DAMAGE OR ALTERATIONS CAUSED DURING EXECUTION OF THIS PROJECT, TO THE ORIGINAL CONDITION OF THIRD PARTY'S PROPERTY (E.G. STRUCTURES, EXISTING UTILITIES OR UTILITY EASEMENTS) LOCATED WITHIN OR OUT OF THE PROJECT BOUNDARIES.
- 13. CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR THE PROTECTION OF ALL PROJECT-RELATED MATERIALS OR EQUIPMENT, BEFORE INSTALLATION, UNTIL FINAL WRITTEN ACCEPTANCE APPROVAL OF THE PROJECT BY THE DPU PROJECT MANAGER AND THE COUNTY.
- 14. ALL MATERIAL QUALITY TESTS SHALL BE PERFORMED BY A RECOGNIZED LABORATORY. SUCH A LABORATORY SHALL BE OPERATED UNDER THE AUSPICES/DIRECTION OF AN NMPE. NAME AND CONTACT OF THE LABORATORY SHALL BE SUBMITTED BY THE CONTRACTOR TO THE DPU PROJECT MANAGER AS SOON AS PRACTICAL AFTER THE CONTRACTOR'S RECEIPT OF THE NOTICE TO PROCEED.
- 15. CONTRACTOR SHALL PROVIDE THE INSTALLATION AND MAINTENANCE OF ANY NECESSARY TRAFFIC CONTROL DEVICES AS OTHERWISE REQUIRED BY LOS ALAMOS COUNTY TRAFFIC MANAGER. TRAFFIC CONTROL DEVICES SHALL COMPLY WITH THE MOST CURRENT EDITION OF THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES (MUTCD), BUT MAY BE REVISED UNDER WRITTEN DIRECTION FROM THE COUNTY TRAFFIC ENGINEER.
- 16. CONTRACTOR SHALL NOTIFY THE DPU PROJECT MANAGER, AT LEAST FIVE (5) DAYS IN ADVANCE OF ANY WORK THAT MAY AFFECT THE OPERATION OF THE PUBLIC UTILITY SYSTEMS (WATER, WASTEWATER, GAS AND ELECTRIC).
- 17. ALL STRUCTURAL OR UTILITY TRENCH FILL OR BACKFILL SHALL BE FREE OF VEGETATION AND DEBRIS AND CONTAIN NO ROCKS LARGER THAN 3-INCHES.
- 18. ALL AREAS DISTURBED BY THE CONSTRUCTION ACTIVITIES OF THIS PROJECT, INCLUDING PRIVATE LANDSCAPING, SHALL BE RESTORED.

WATER PIPELINES

- 1. THE PIPELINE SHALL BE SUPPLIED AND INSTALLED IN STRICT COMPLIANCE WITH THE DEPARTMENT OF PUBLIC UTILITIES CONSTRUCTION STANDARDS. CONTRACTOR SHALL NOTIFY THE DPU PROJECT MANAGER IMMEDIATELY UPON ENCOUNTERING FIELD CONDITIONS THAT MAY REQUIRE DEVIATIONS FROM THESE STANDARDS.
 - 2. CONTRACTOR SHALL INSTALL PIPELINE SO THAT HIGH POINTS ARE NOT CREATED, UNLESS SPECIFICALLY SHOWN ON APPROVED CONSTRUCTION DRAWINGS. THE PIPE SHALL BE PLACED WITH A UNIFORM GRADE, NO VERTICAL BENDS ARE ALLOWED.
 - 3. MINIMUM BURY SHALL BE 48 INCHES FOR MAINS AND 36 INCHES FOR SERVICE LINES, AT ALL POINTS ALONG THE ALIGNMENT.
 - 4. ALL FIRE HYDRANTS SHALL BE INSTALLED WITH A MINIMUM 4-FOOT HORIZONTAL CLEARANCE ALL AROUND THEM.
- CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR THE DISINFECTION, CHLORINATION, CHLORINE RESIDUAL TESTING, AND HYDROSTATIC (PRESSURE) TESTING OF ALL WATER PIPES INSTALLED. PRESSURE TEST SHALL BE DOCUMENTED ON FORM INCLUDED IN STANDARD SPECIFICATION. DPU PROJECT MANAGER SHALL WITNESS ALL SUCH TESTING




REVISION DESCRIPTION				
NO.	1	2	3	4

DESIGNED BY: SH	DRAWN BY: SH	APPROVED BY: JAM	DATE: 10/24/2024

SAN ILDEFONSO ROAD
8" WATERLINE REPLACEMENT

CONSTRUCTION NOTES



INCORPORATED COUNTY
OF LOS ALAMOS
DEPARTMENT OF PUBLIC UTILITIES
1000 CENTRAL AVE., SUITE 130
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109

Drawing File: L:\PROJECTS\1518 2025-XX SAN ILDEFONSO WATER LINE03_DESIGN\CAD_DWGSEXISTING_UTILITIES.DWG

Drawing File: L:\PROJECTS\100-XX-SAN ILDEFONSO WATER LINE\03_DESIGN\DWG\EXISTING UTILITIES.DWG



GENERAL NOTES

- NEW WATER LINE SHALL CONSIST OF APPROXIMATELY 4800' OF 12" PVC, AWWA C900, DR-18 CLASS 19 PIPE
- PROJECT INCLUDES THE INSTALLATION OF TWO NEW PRESSURE REDUCING VAULTS AND APPURTENANCES. TWO EXISTING VAULTS ARE TO BE ABANDONED.
- THREE ADDITIONAL PRV VAULTS REQUIRE REHABILITATION AND VALVE REPLACEMENT.
- CONNECTIONS BETWEEN NEW WATER LINE AND NEW PRVS SHALL CONSIST OF TWO SECTIONS TOTALING APPROXIMATELY 190' OF 8" PVC, AWWA C900, DR-18 CLASS 19 PIPE

Attachment B



INCORPORATED COUNTY
OF LOS ALAMOS
DEPARTMENT OF PUBLIC UTILITIES
100 CENTRAL AVE. SUITE 130
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109

SHEET



2

SAN ILDEFONSO ROAD
8" WATERLINE REPLACEMENT
PROJECT OVERVIEW

DESIGNED BY: SH
DRAWN BY: SH
APPROVED BY: JAM
DATE: 10/24/2024
SCALE:

NO.	REVISION DESCRIPTION
1	
2	
3	
4	
5	

Drawing File: L:\PROJECTS\IFB 2025-XX SAN ILDEFONSO WATER LINE\03 DESIGN\CAD DWGS\40 SCALE SHEETS\3 SHEET 3.DWG

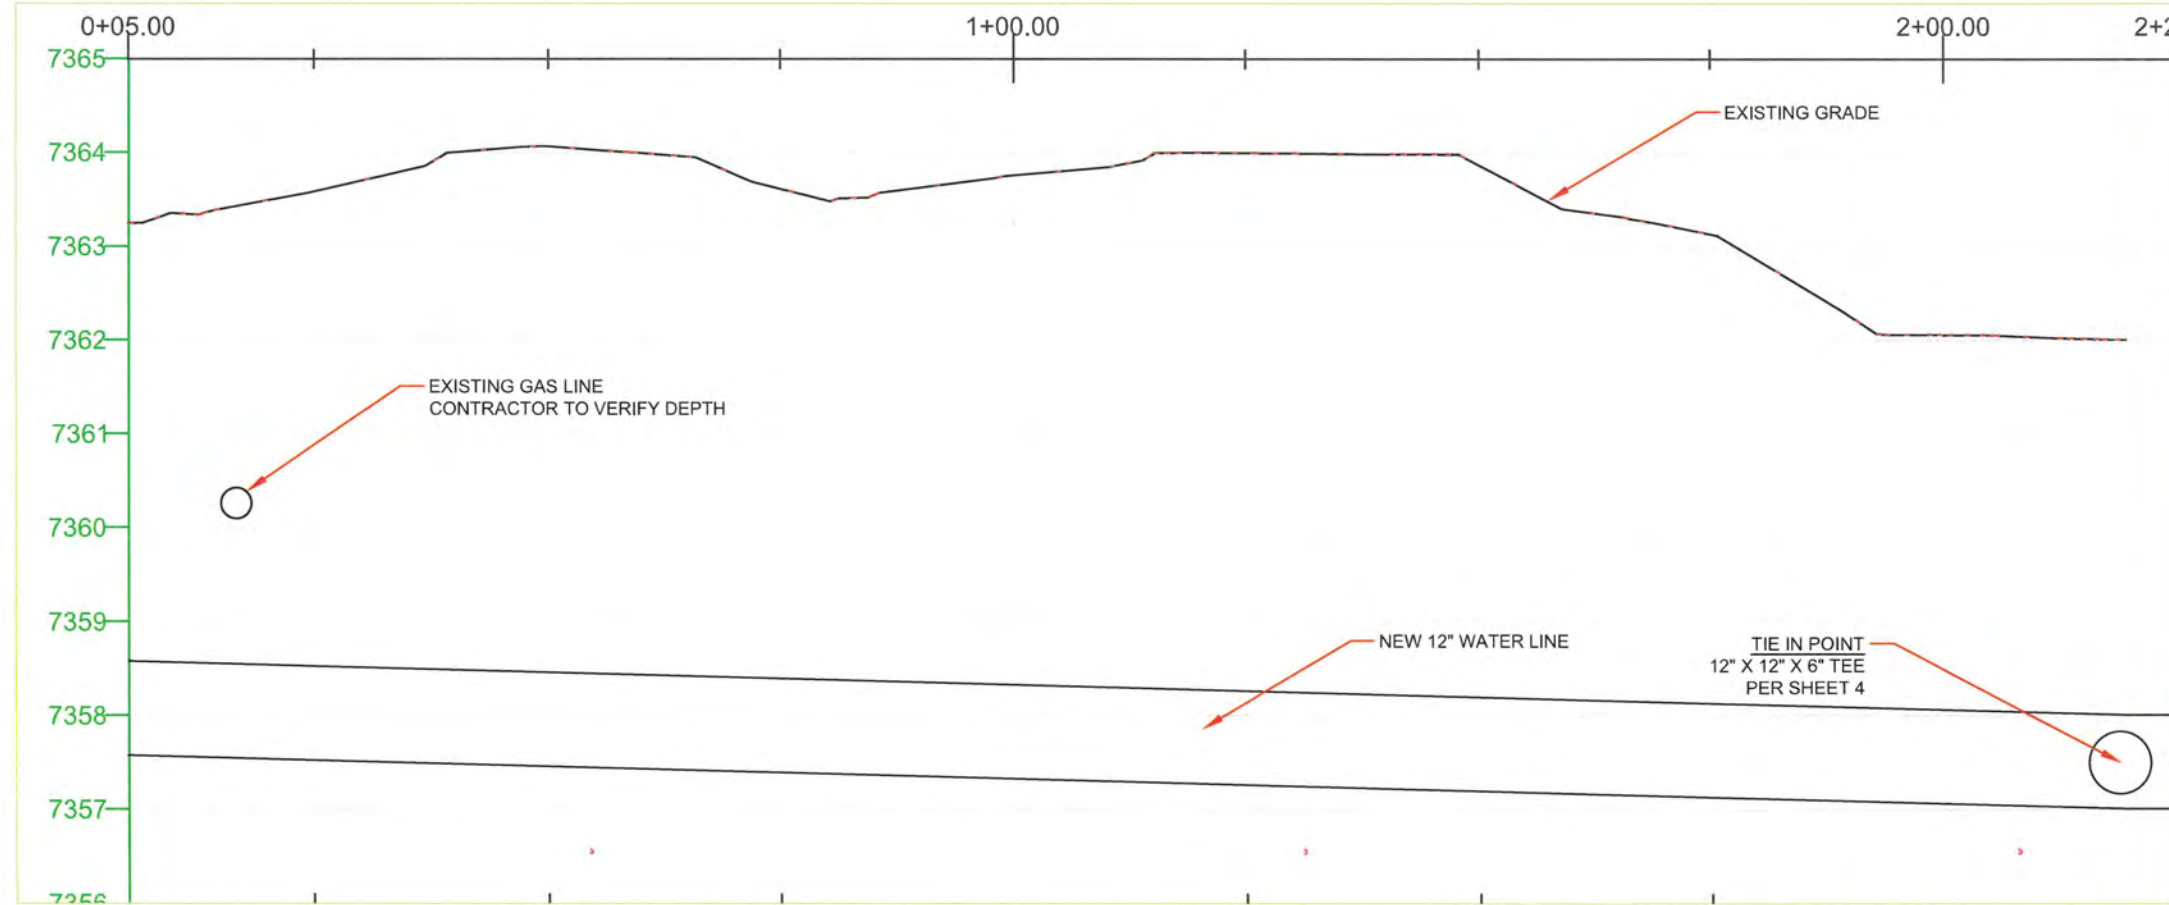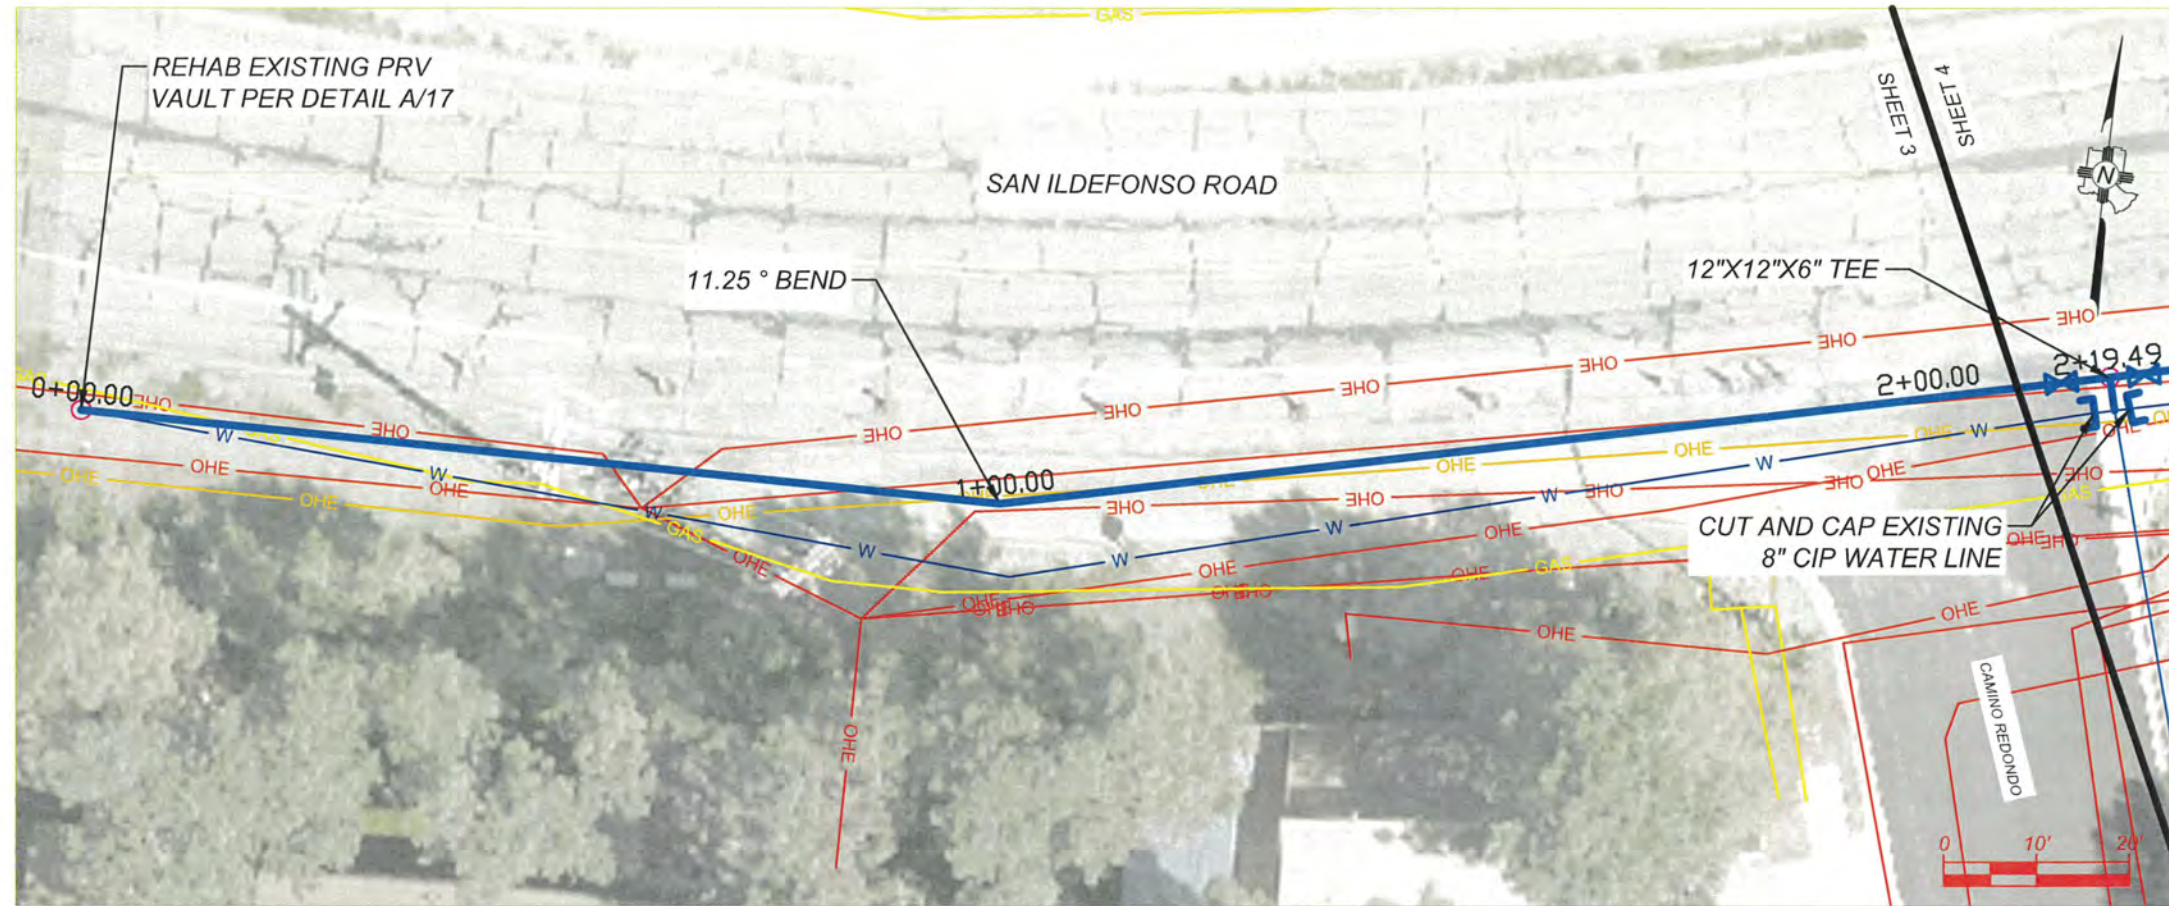

LEGEND

	NEW WATER LINE
	NEW GATE VALVE
	OHE EXISTING OVERHEAD ELECTRIC
	UGE EXISTING UNDERGROUND ELECTRIC
	W EXISTING WATER LINE
	GAS EXISTING GAS LINE
	OHE EXISTING OVERHEAD COM LINE
	SAS EXISTING SEWER LINE

REVISION DESCRIPTION	
NO.	
1	
2	
3	
4	
5	

DESIGNED BY:	SH
DRAWN BY:	SH
APPROVED BY:	JM
DATE:	3/31/2025
SCALE:	1"=20'

SAN ILDEFONSO ROAD
8" WATERLINE REPLACEMENT

12" WATERLINE ALIGNMENT




LOS ALAMOS

INCORPORATED COUNTY
OF LOS ALAMOS


PUBLIC WORKS DEPARTMENT
1000 CENTRAL AVE., SUITE 160
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109



SHEET
3

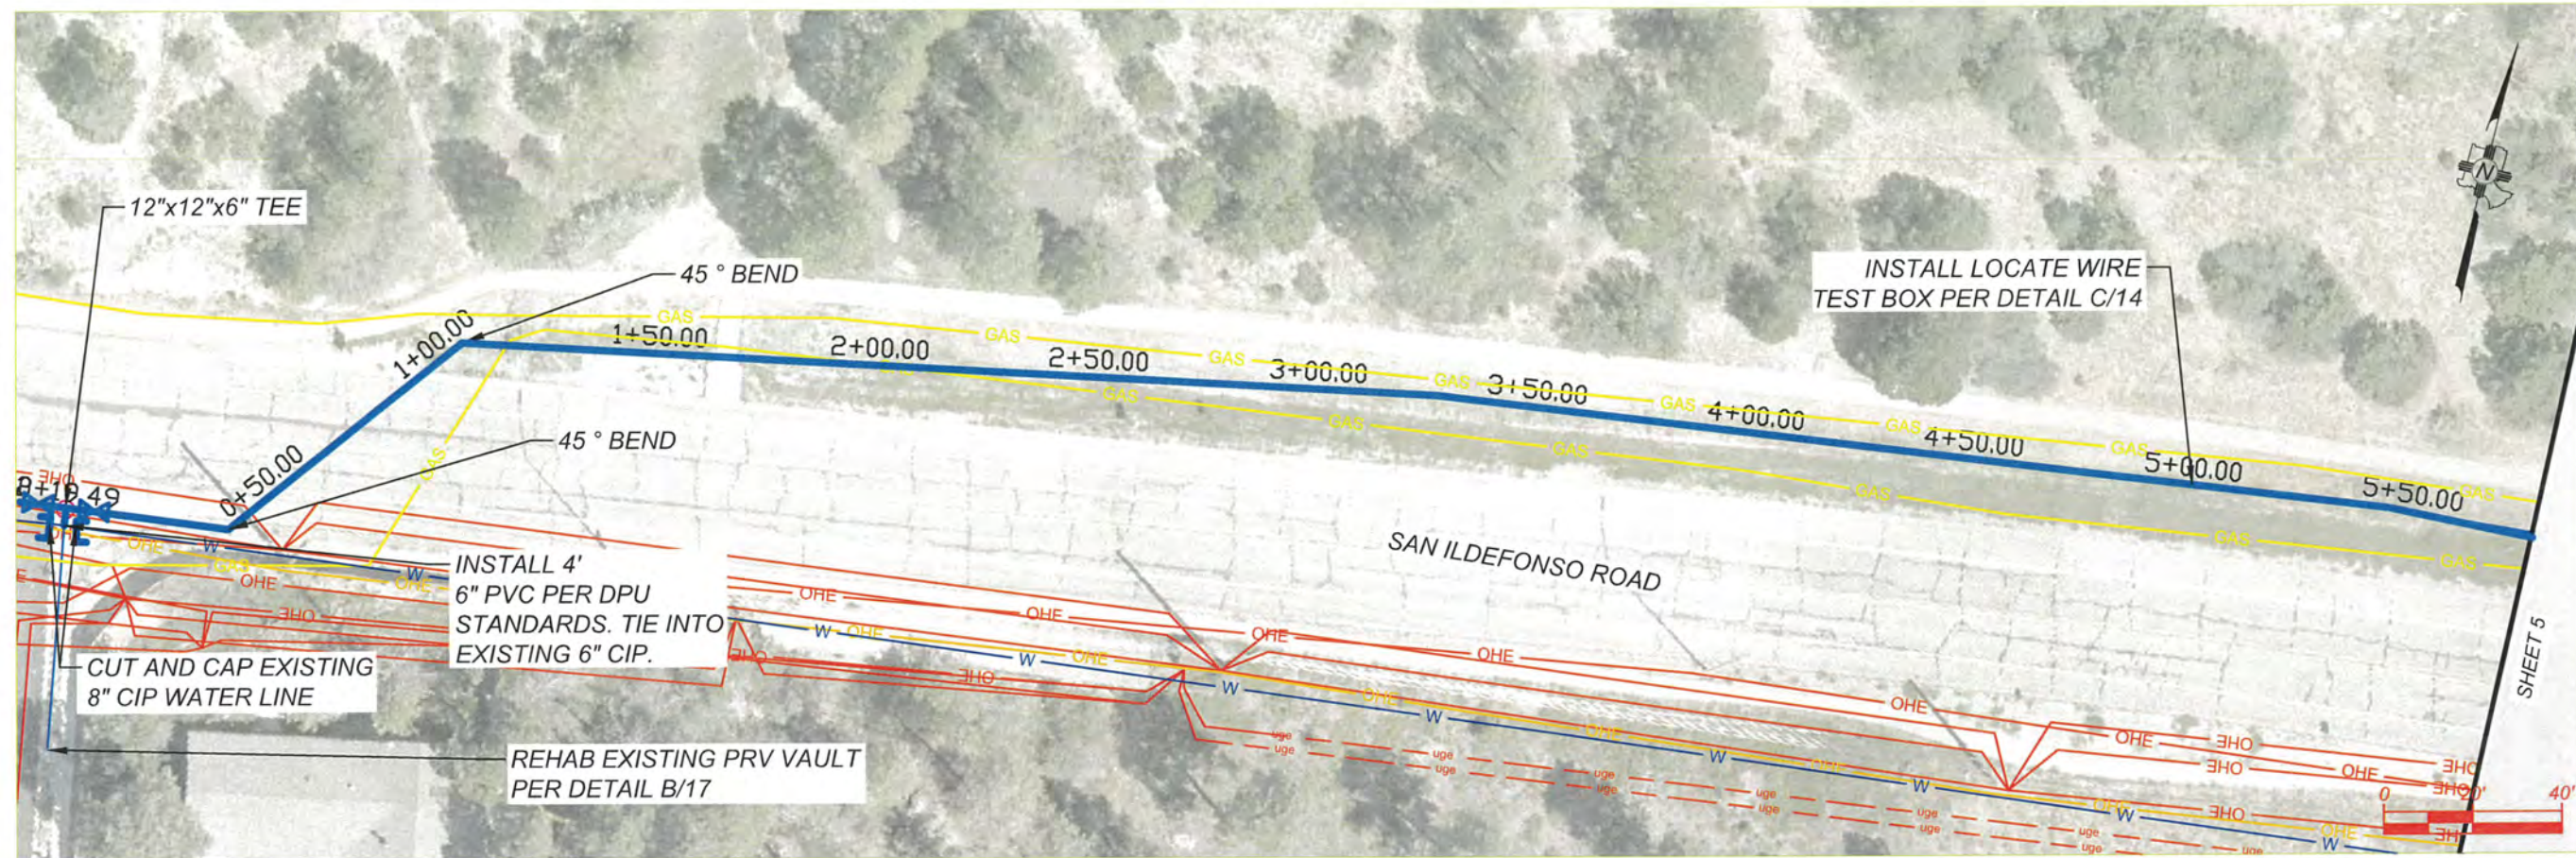

NEW 12" HYDRAULIC PROFILE - ADJUST GRADE PER FIELD CONDITIONS

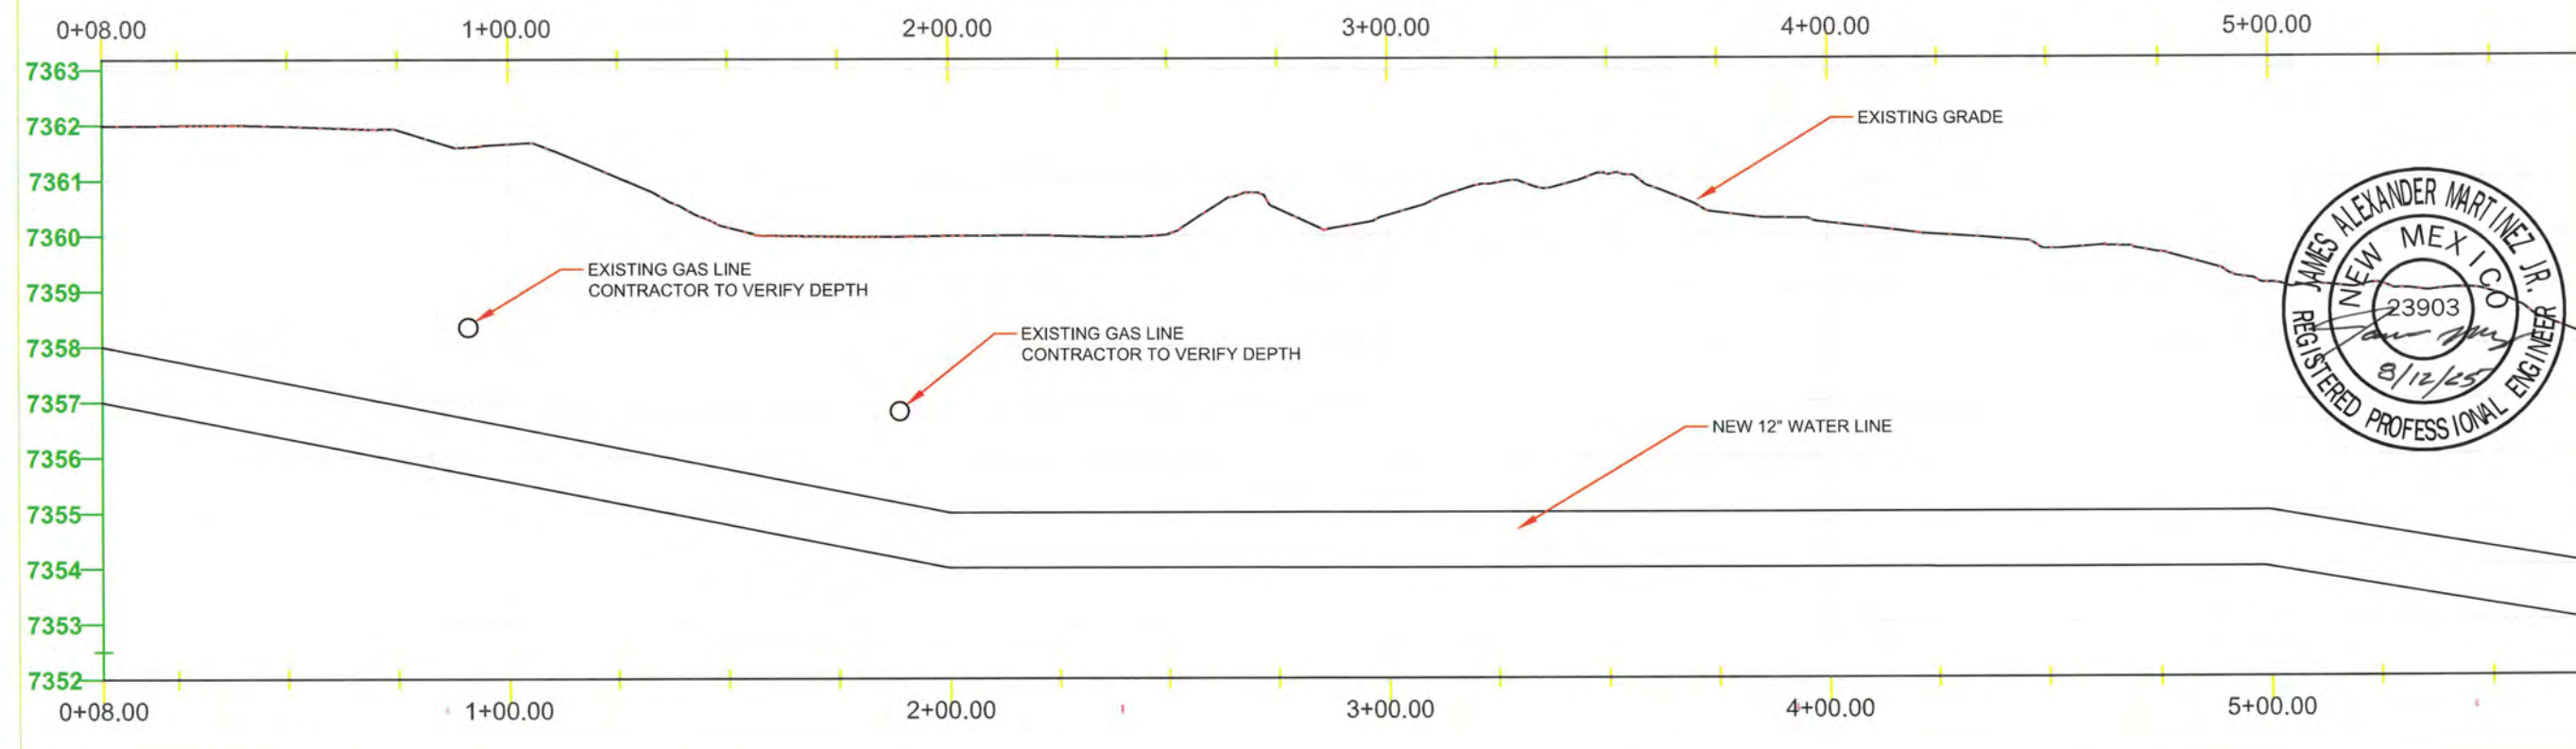

REVISION DESCRIPTION	
NO.	DESCRIPTION
1	
2	
3	
4	
5	

DESIGNED BY: SH	SH
DRAWN BY: JM	JM
APPROVED BY: JM	JM
DATE: 3/31/2025	
SCALE: 1"=40'	



SAN ILDEFONSO ROAD	
8" WATERLINE REPLACEMENT	
12" WATERLINE ALIGNMENT	

LOS ALAMOS

INCORPORATED COUNTY OF LOS ALAMOS	PUBLIC WORKS DEPARTMENT 1000 CENTRAL AVE., SUITE 160 LOS ALAMOS, NEW MEXICO 87544 (505) 662-8150 FAX: (505) 662-8109
-----------------------------------	---

SHEET 4

Drawing File: L:\PROJECTS\IFB 2025-XX SAN ILDEFONSO WATER LINE\03 DESIGN\CAD_DWG\540 SCALE SHEET\5 SHEET 5.DWG

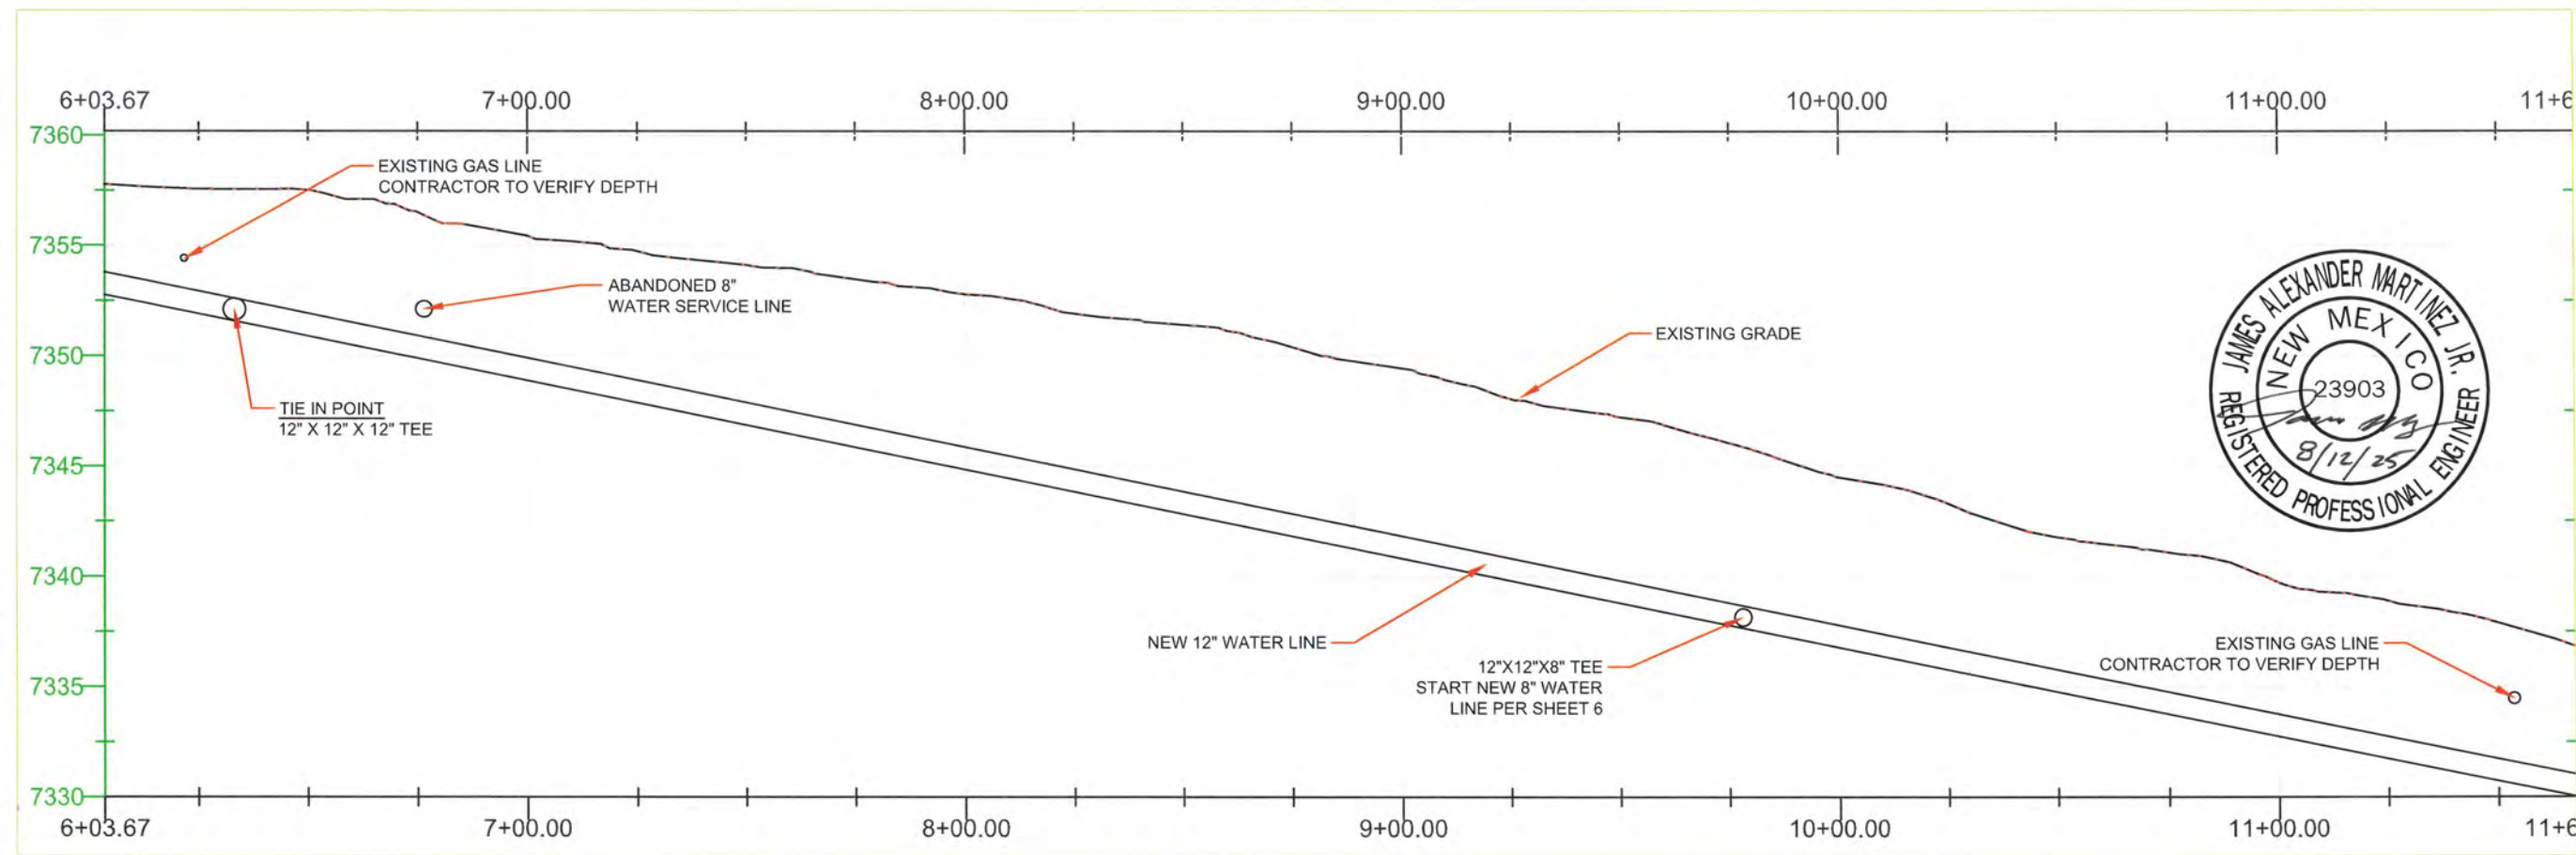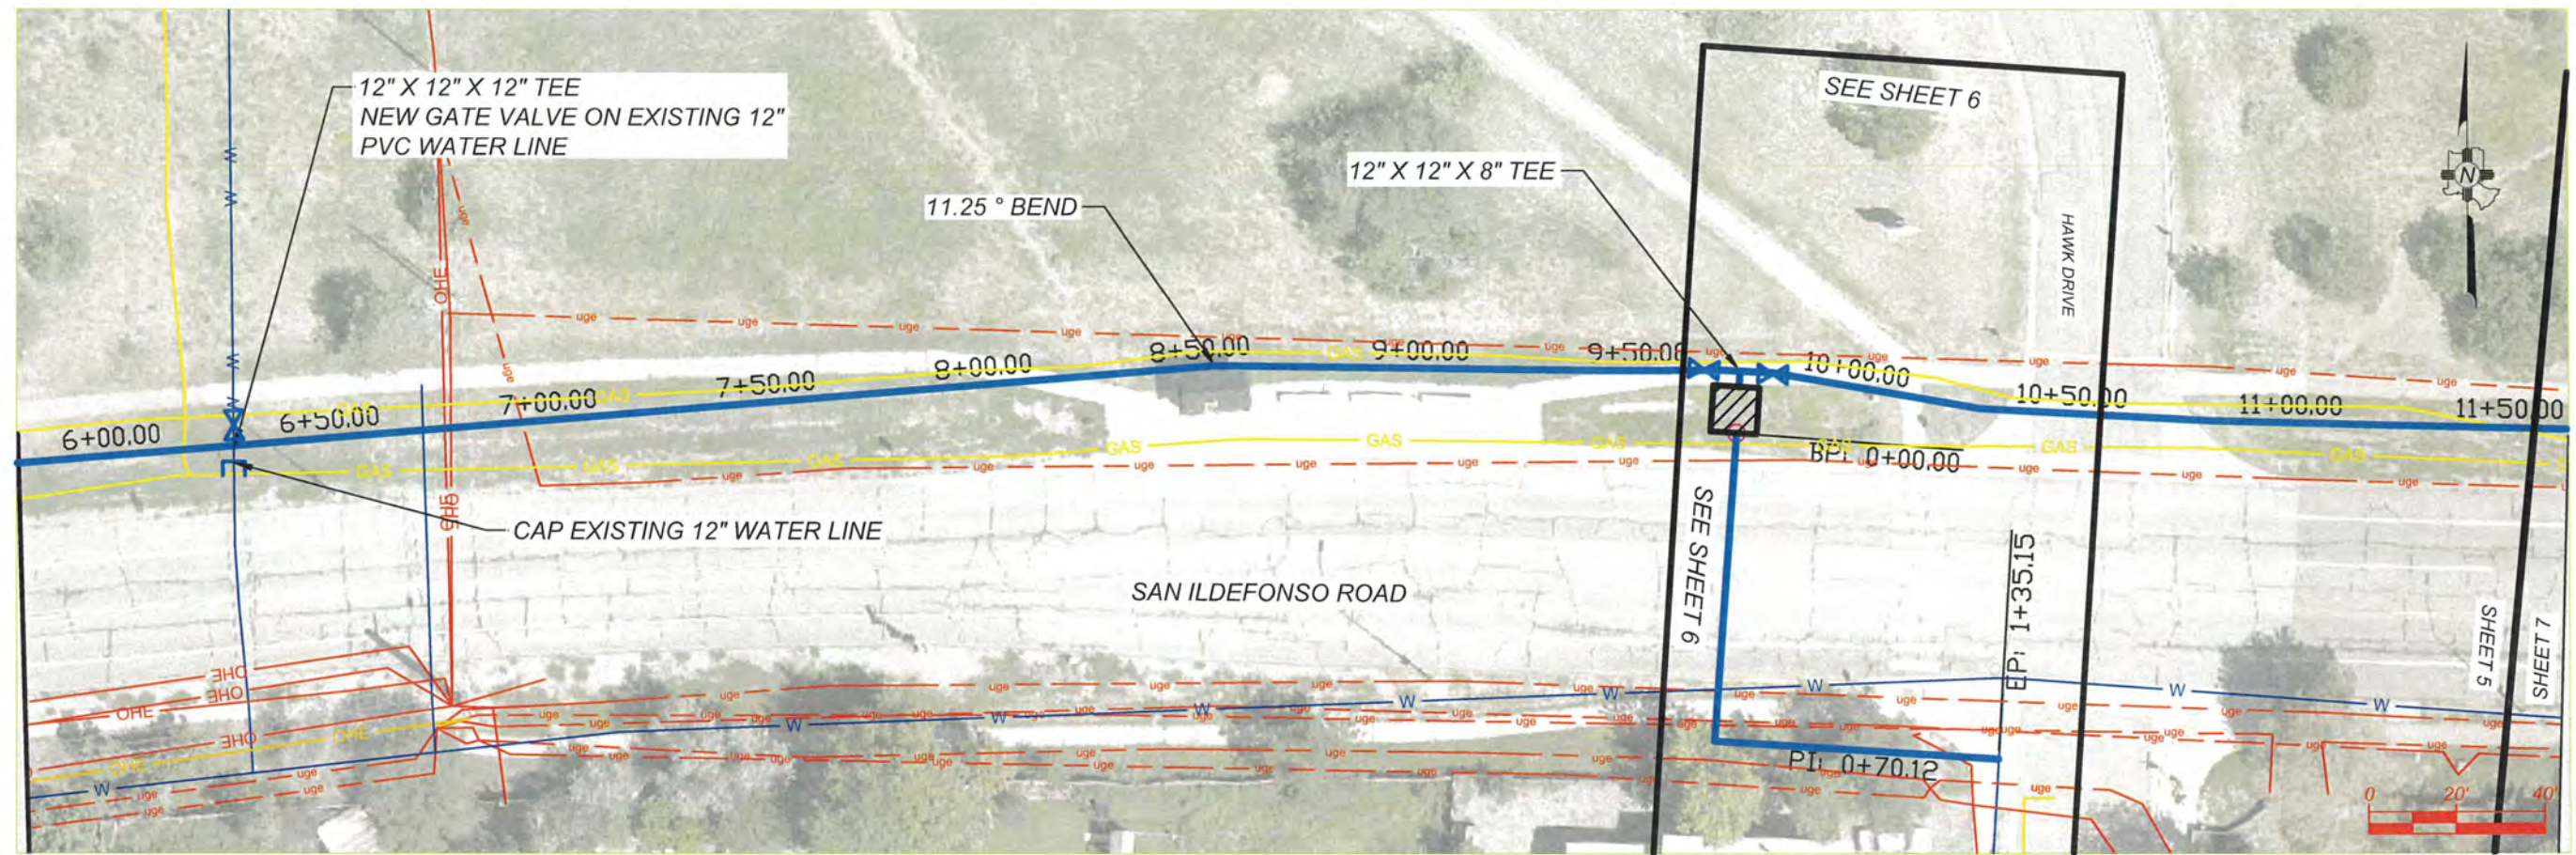

REVISION DESCRIPTION	
NO.	
1	
2	
3	
4	
5	

DESIGNED BY:	SH
DRAWN BY:	SH
APPROVED BY:	JM
DATE:	3/31/2025
SCALE:	1"=40'

SAN ILDEFONSO ROAD

8" WATERLINE REPLACEMENT


12" WATERLINE ALIGNMENT



INCORPORATED COUNTY
OF LOS ALAMOS

PUBLIC WORKS DEPARTMENT
1000 CENTRAL AVE., SUITE 160
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109

Drawing File: L:\PROJECTS\IFB 2025-XX SAN ILDEFONSO WATER LINE\03 DESIGN\CAD_DWG\SSHEET 6.DWG

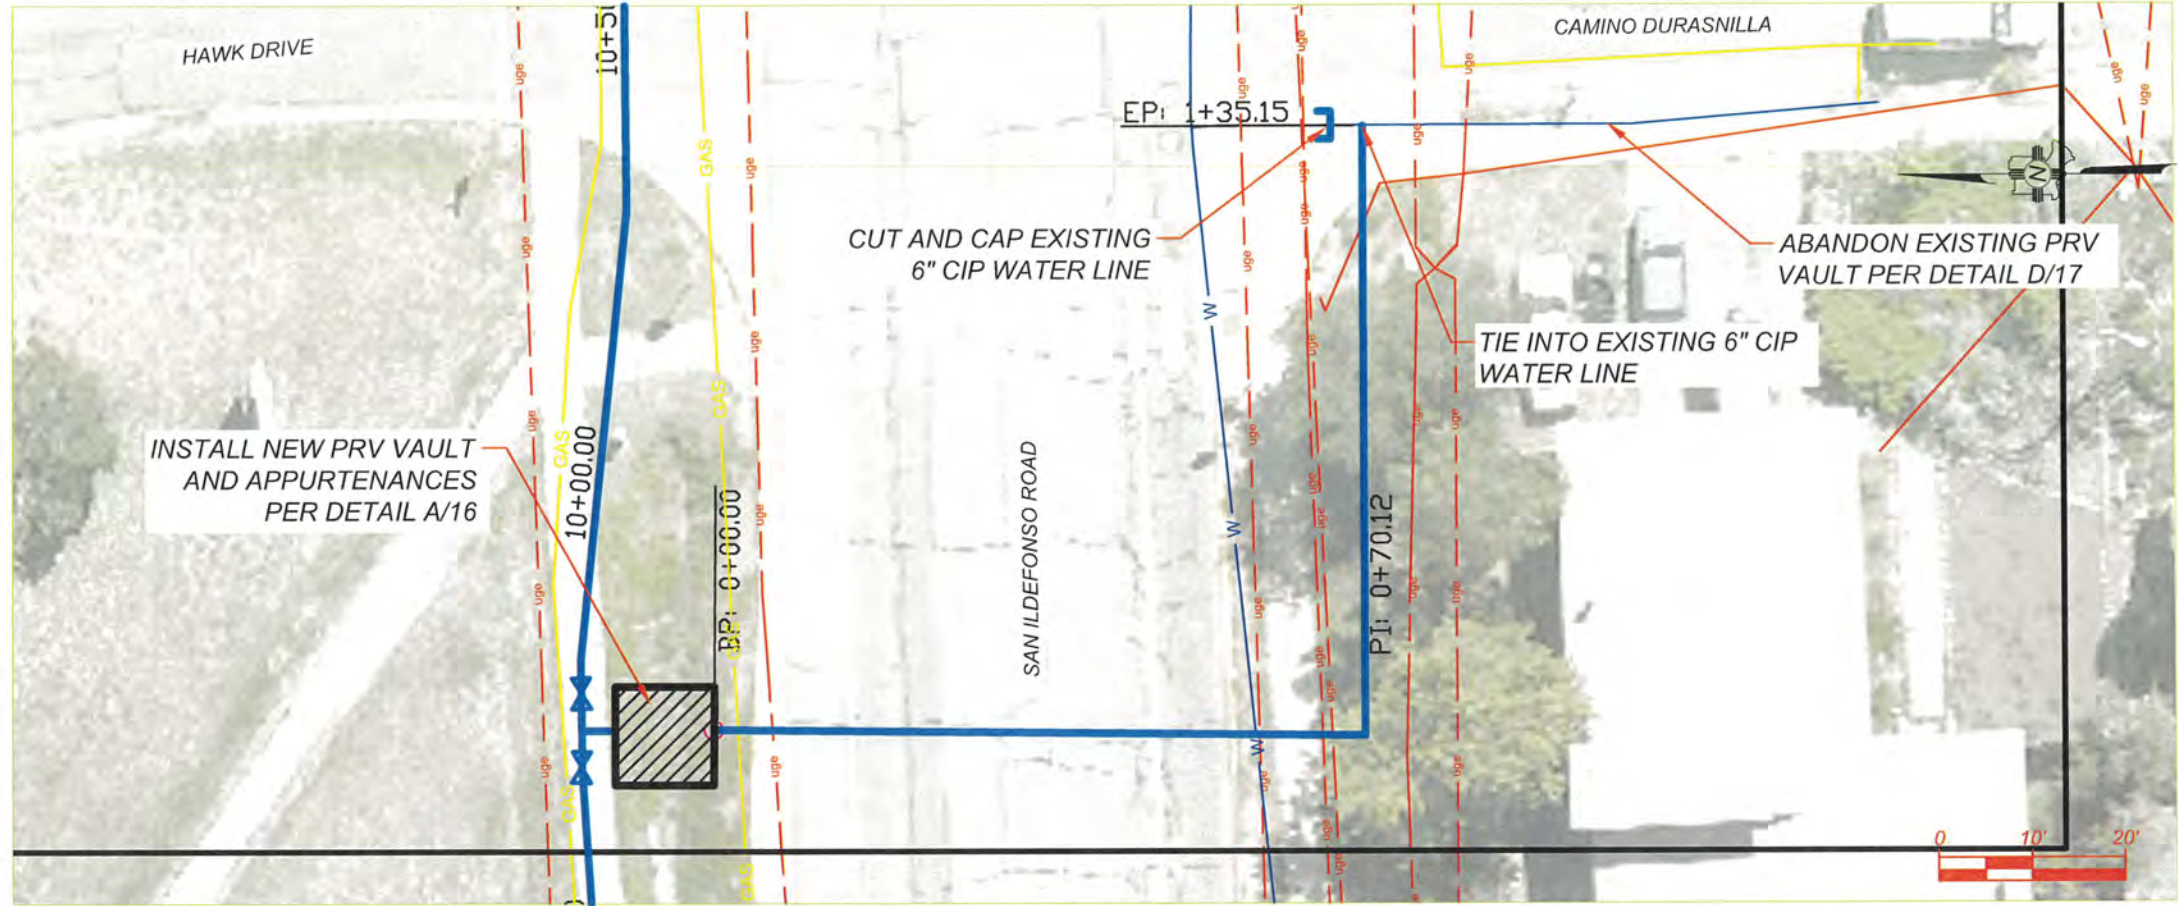


LEGEND

	NEW WATER LINE
	NEW GATE VALVE
	EXISTING OVERHEAD ELECTRIC
	EXISTING UNDERGROUND ELECTRIC
	EXISTING WATER LINE
	EXISTING GAS LINE
	EXISTING OVERHEAD COM LINE
	EXISTING SEWER LINE

GENERAL NOTE:

ALL UTILITIES SHALL HAVE A MINIMUM OF 12" VERTICAL AND HORIZONTAL SEPARATION

NEW 8" HYDRAULIC PROFILE - CONTRACTOR TO POTHOLE EVERY UTILITY CROSSING PRIOR TO TRENCHING

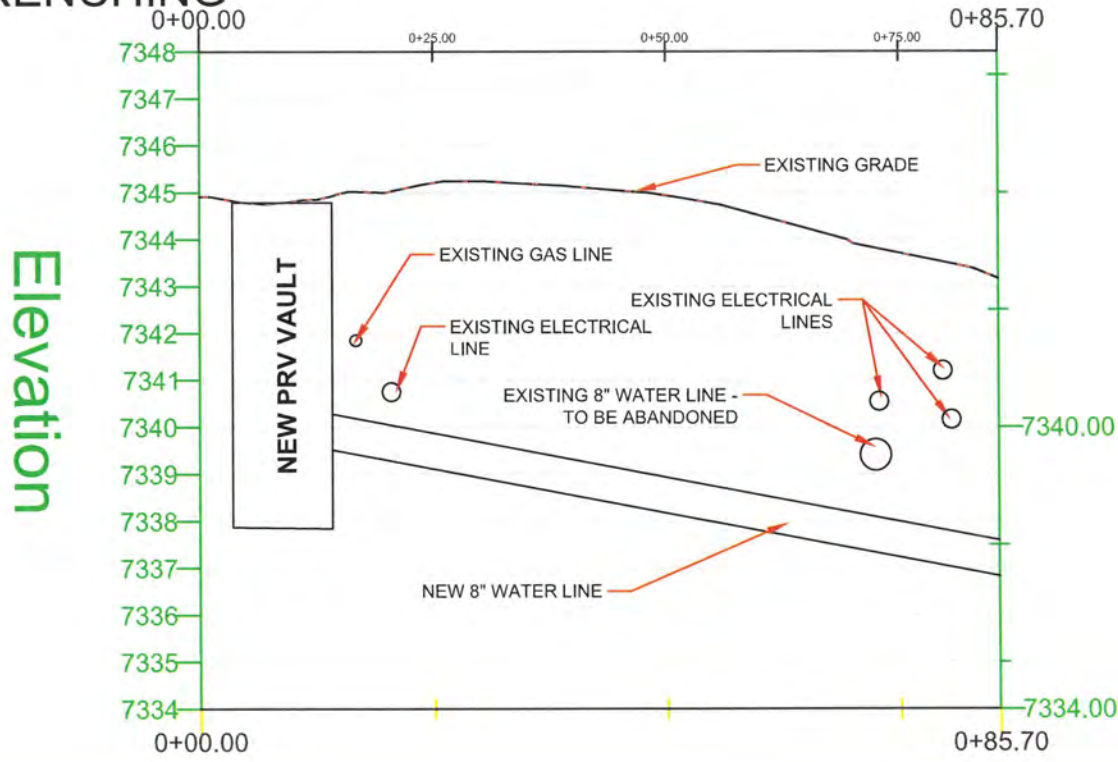

REVISION DESCRIPTION	
NO.	
1	
2	
3	
4	
5	

DESIGNED BY:	SH
DRAWN BY:	SH
APPROVED BY:	JM
DATE:	3/31/2025
SCALE:	1"=20'



SAN ILDEFONSO ROAD
8" WATERLINE REPLACEMENT
8" WATERLINE ALIGNMENT



INCORPORATED COUNTY
OF LOS ALAMOS
PUBLIC WORKS DEPARTMENT
1000 CENTRAL AVE., SUITE 160
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109

SHEET
6

Drawing File: L:\PROJECTS\IFB 2025-XX SAN ILDEFONSO WATER LINE\03 DESIGN\CAD_DWG\04 SCALE SHEETS\01 SHEET 8.DWG

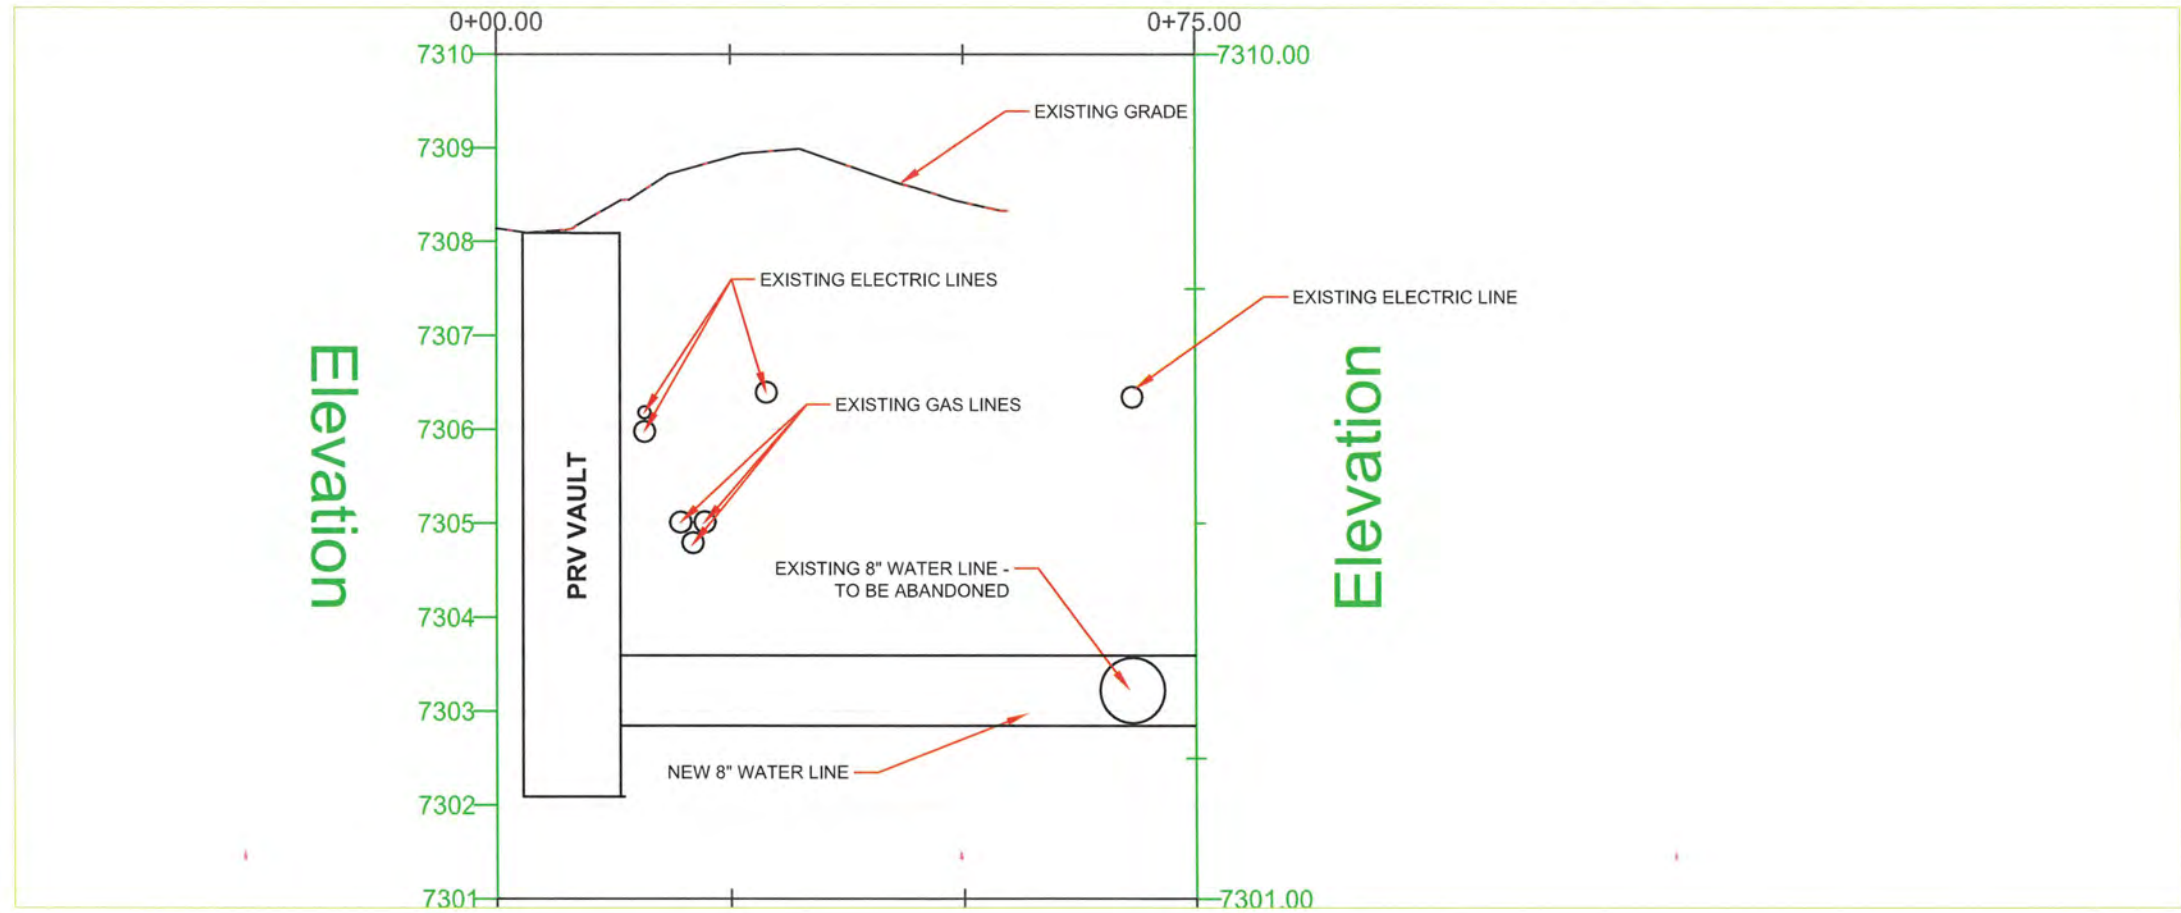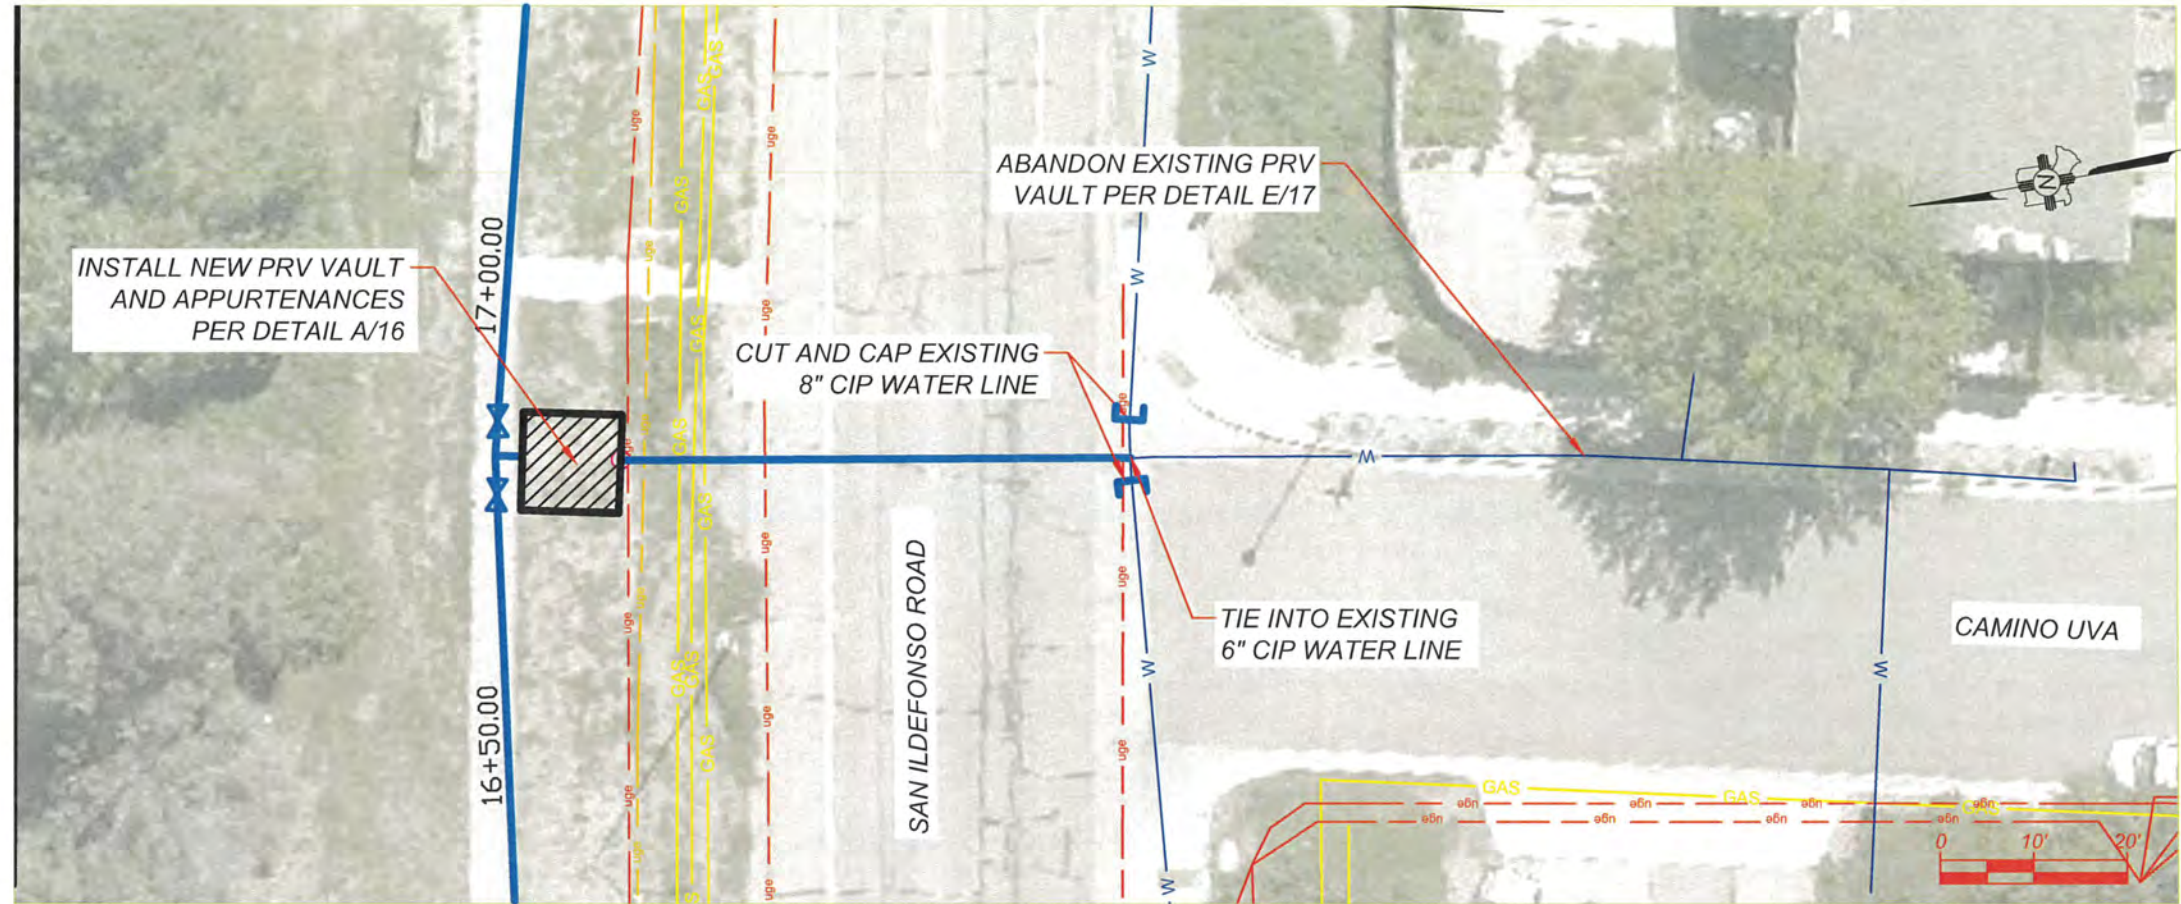

LEGEND

	NEW WATER LINE
	NEW GATE VALVE
	EXISTING OVERHEAD ELECTRIC
	EXISTING UNDERGROUND ELECTRIC
	EXISTING WATER LINE
	EXISTING GAS LINE
	EXISTING OVERHEAD COM LINE
	EXISTING SEWER LINE

GENERAL NOTE:

CONTRACTOR TO
POTHOLE EVERY UTILITY
CROSSING PRIOR TO
TRENCHING



REVISION DESCRIPTION	
NO.	
1	
2	
3	
4	
5	

DESIGNED BY:	SH
DRAWN BY:	SH
APPROVED BY:	JM
DATE:	3/31/2025
SCALE:	1"=20'



SAN ILDEFONSO ROAD
8" WATERLINE REPLACEMENT
8" WATERLINE ALIGNMENT



INCORPORATED COUNTY
OF LOS ALAMOS
PUBLIC WORKS DEPARTMENT
1000 CENTRAL AVE., SUITE 160
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109

SHEET
8

Drawing File: L:\PROJECTS\1518 2025-XX SAN ILDEFONSO WATER LINE\03 DESIGN\CAD_DWG\04 SCALE SHEETS\9 SHEET 9.DWG

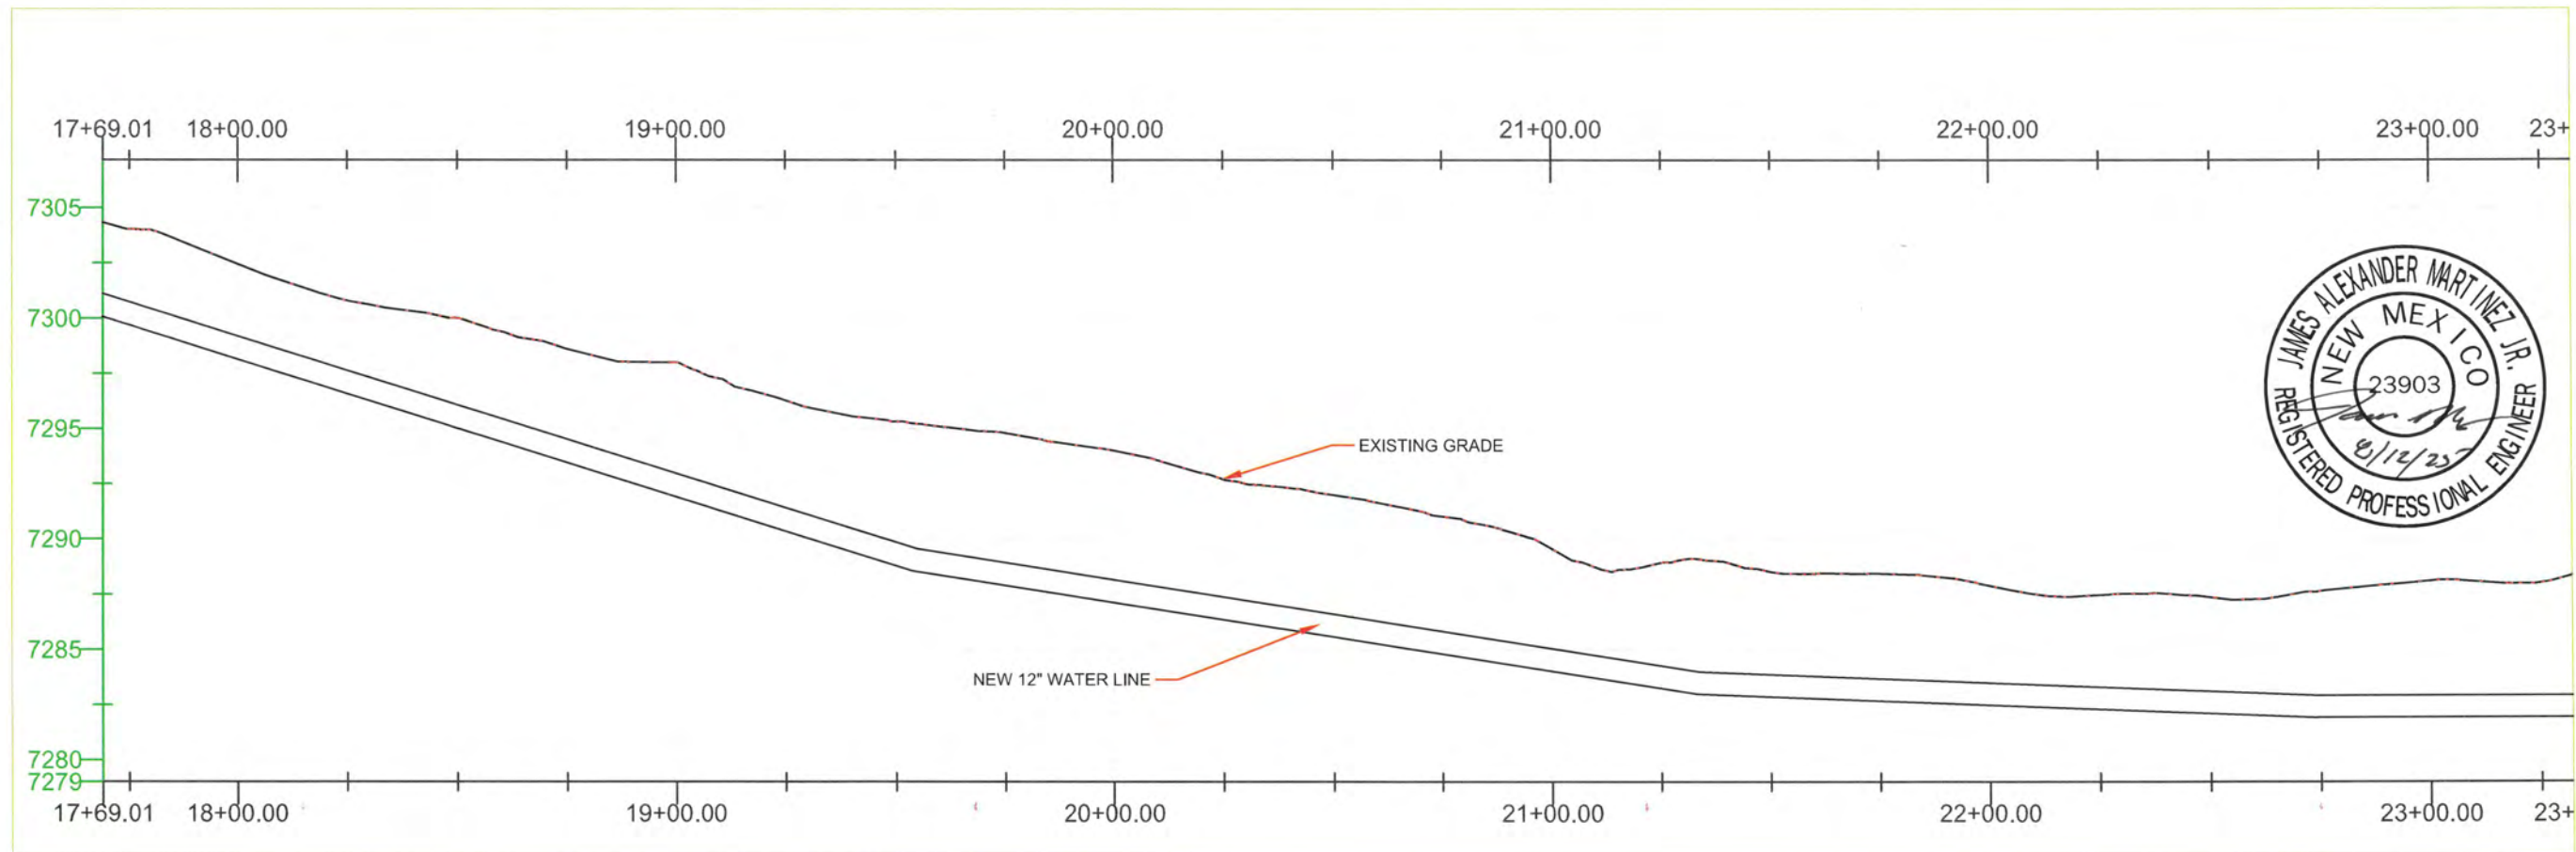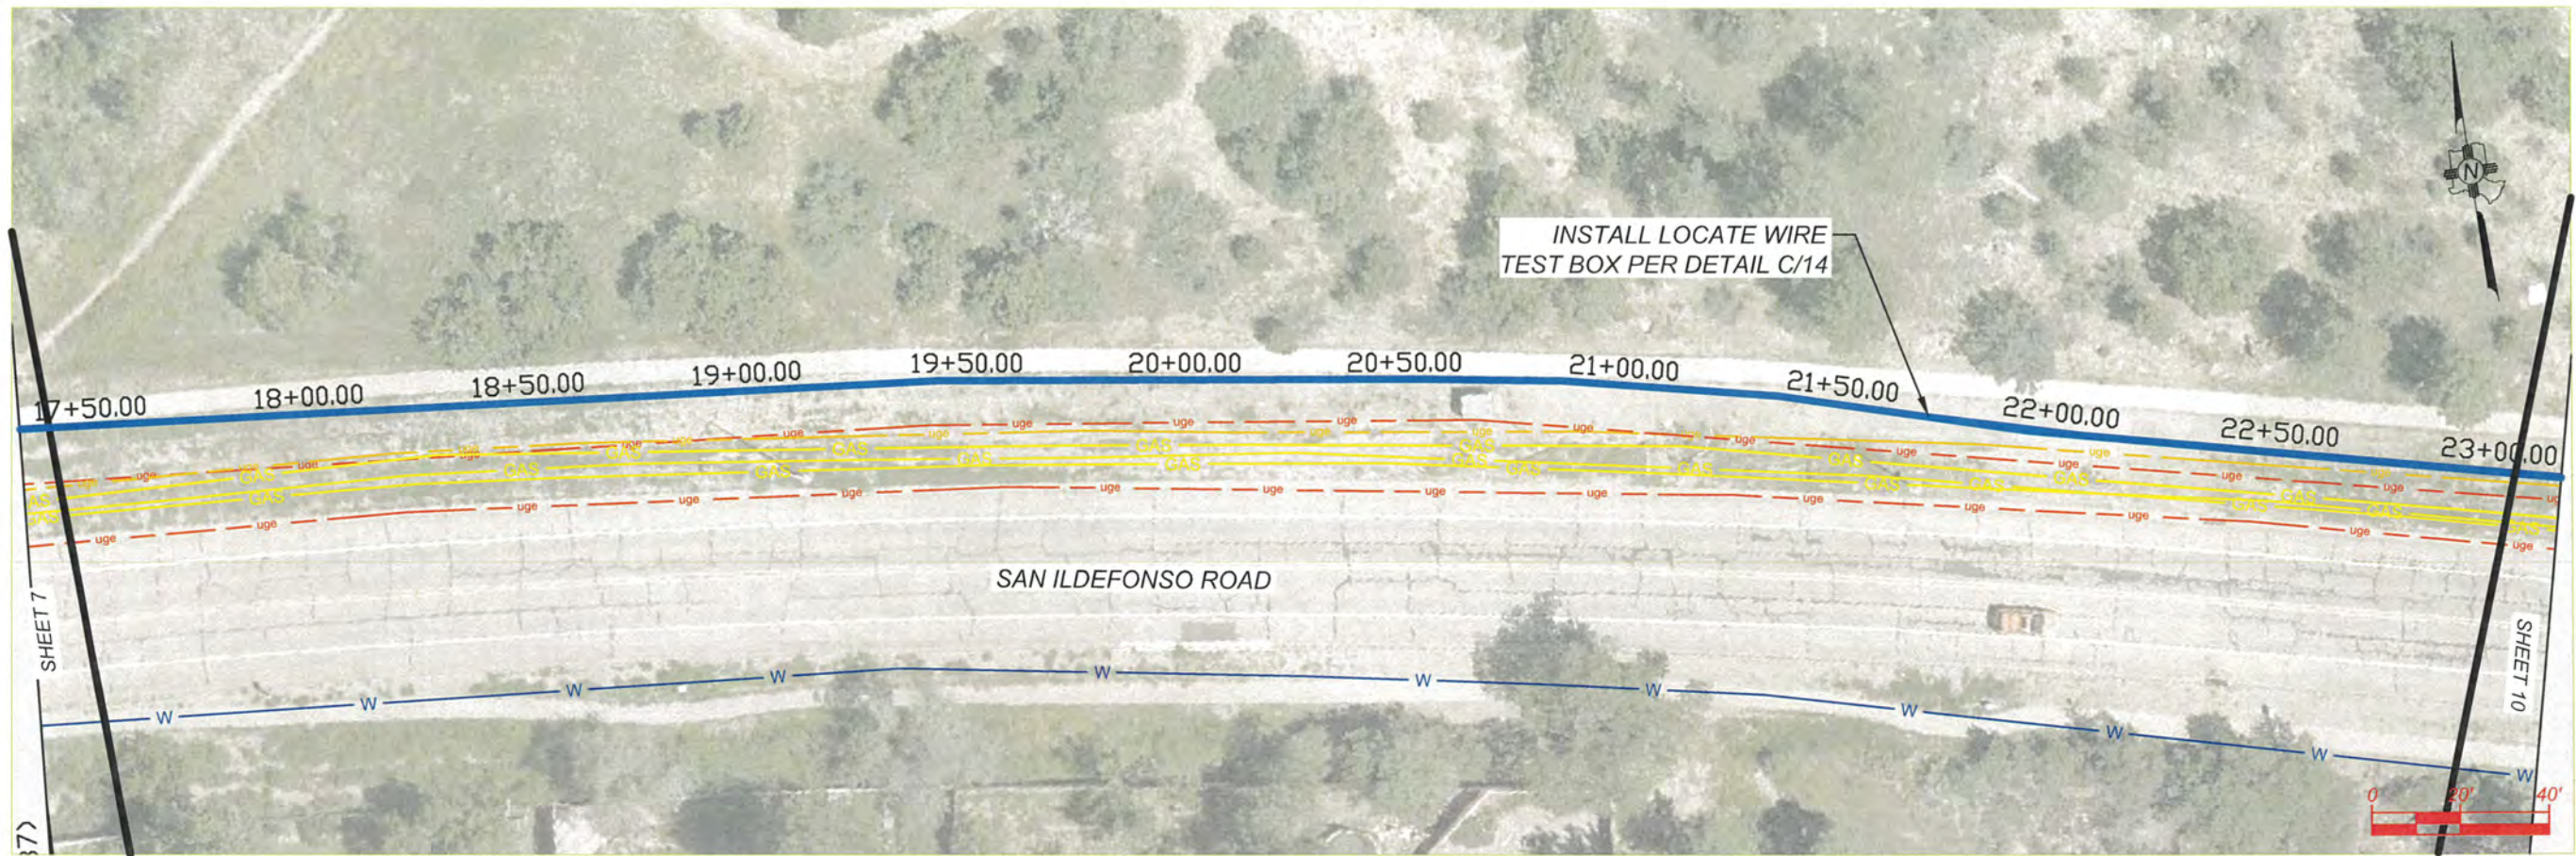

REVISION DESCRIPTION	
NO.	
1	
2	
3	
4	
5	

DESIGNED BY:	SH
DRAWN BY:	SH
APPROVED BY:	JM
DATE:	3/31/2025
SCALE:	1"=40'



SAN ILDEFONSO ROAD	
8" WATERLINE REPLACEMENT	
12" WATERLINE ALIGNMENT	



INCORPORATED COUNTY
OF LOS ALAMOS
PUBLIC WORKS DEPARTMENT
1000 CENTRAL AVE., SUITE 160
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109

SHEET
9

Drawing File: L:\PROJECTS\BFB 2025-KK SAN ILDEFONSO WATER LINE\03 DESIGN\CAD_DWG\SS40 SCALE SHEETS\10.DWG

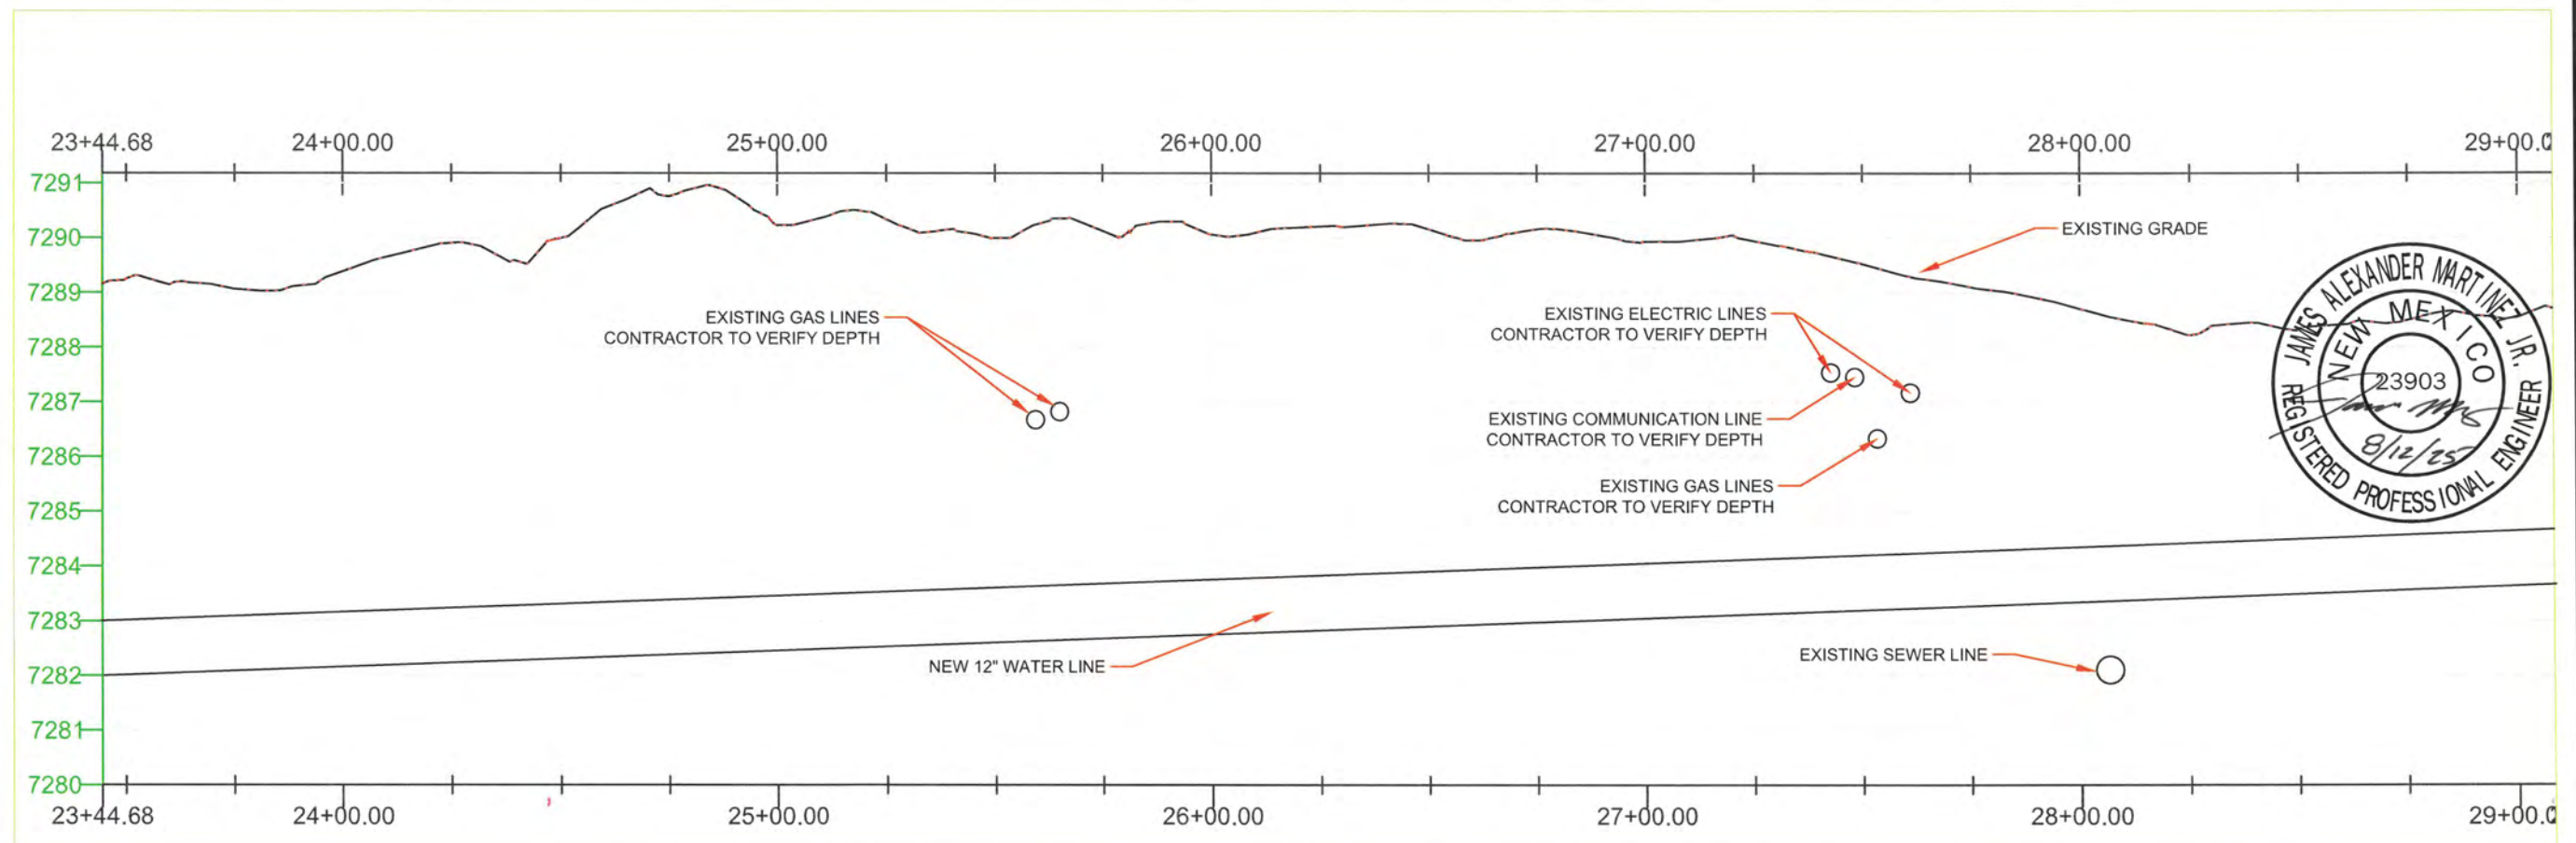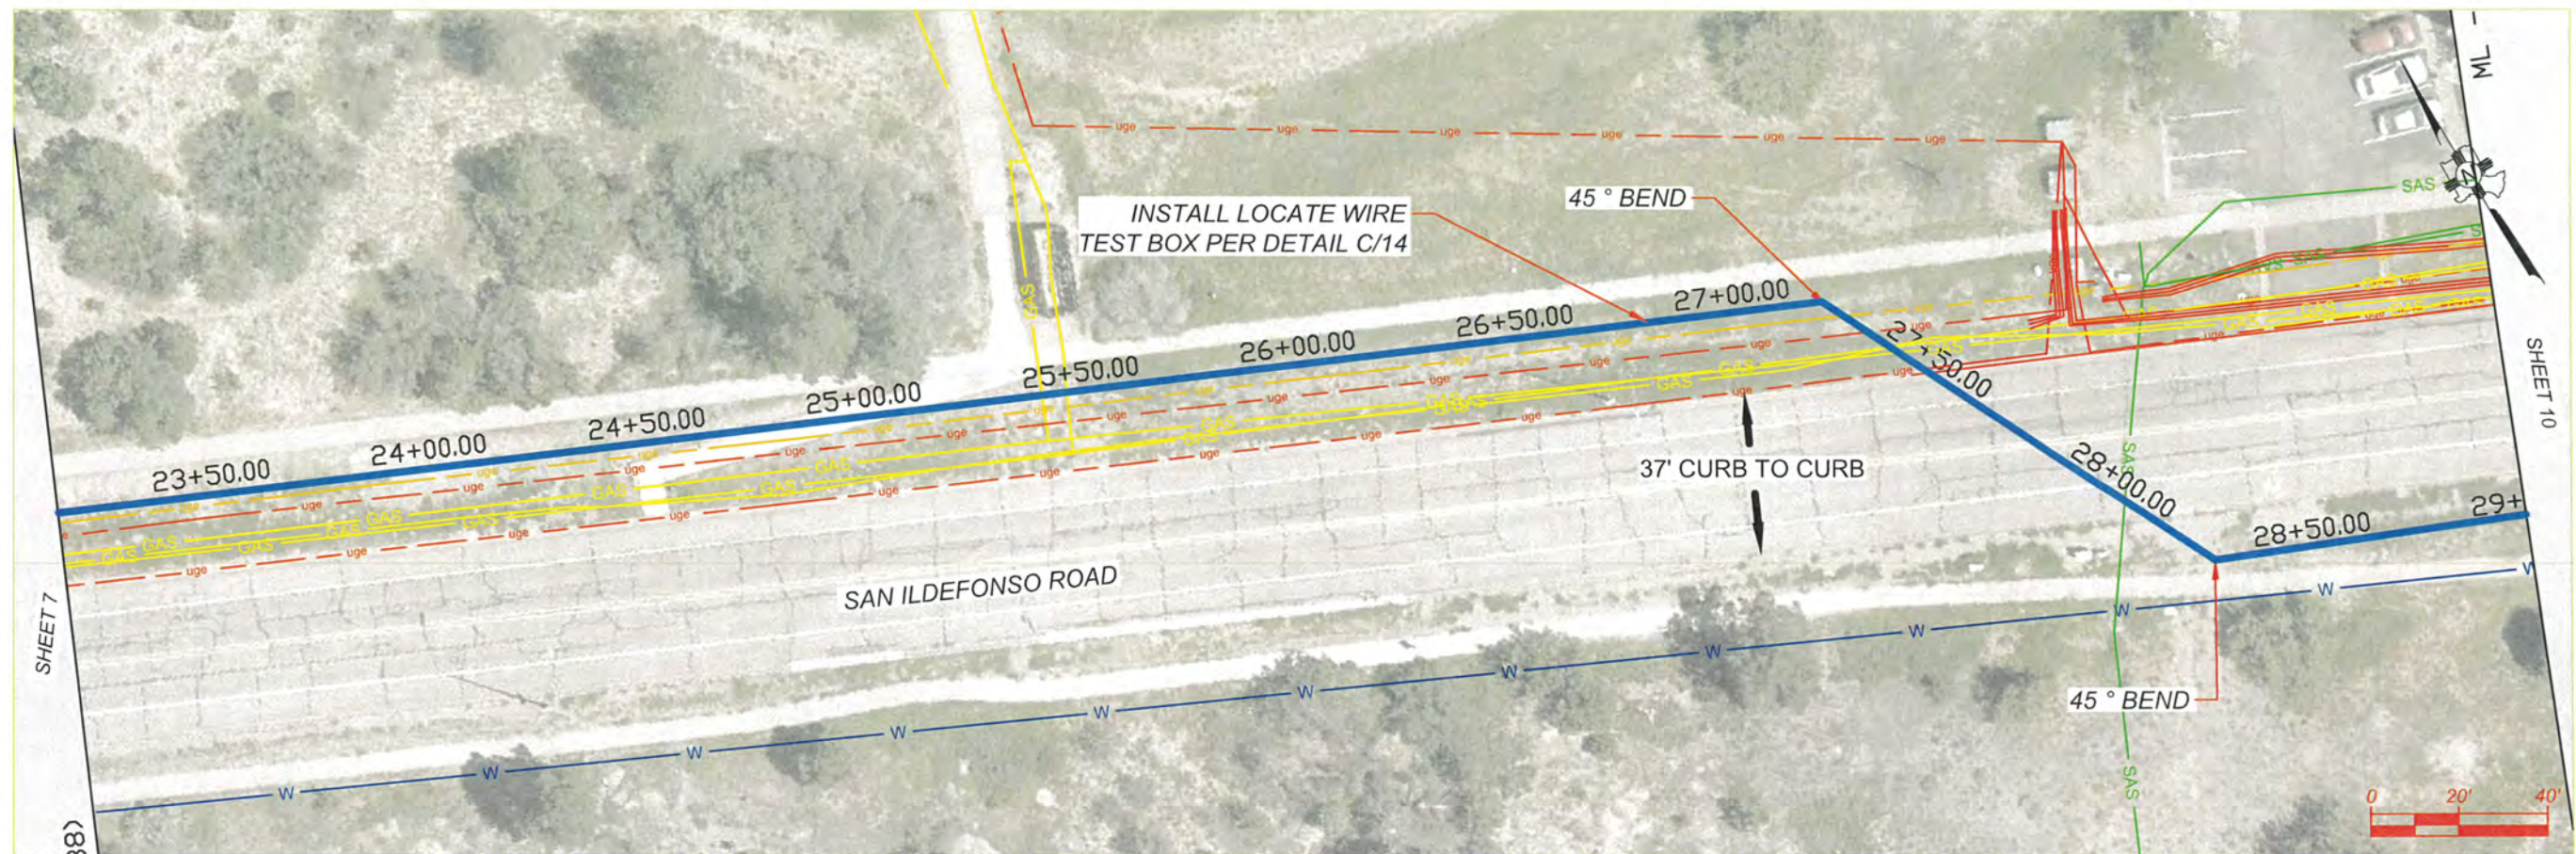

REVISION DESCRIPTION

NO.

SH

DESIGNED BY:

DRAWN BY:

APPROVED BY:

DATE:

SCALE:

1"=40'

3/31/2025

JM

SH

SH

NO.

1

2

3

4

5

SAN ILDEFONSO ROAD

8" WATERLINE REPLACEMENT

12" WATERLINE ALIGNMENT

LOS ALAMOS

INCORPORATED COUNTY

OF LOS ALAMOS

PUBLIC WORKS DEPARTMENT



1000 CENTRAL AVE., SUITE 160

LOS ALAMOS, NEW MEXICO 87544

(505) 662-8150 FAX: (505) 662-8109

SHEET

10

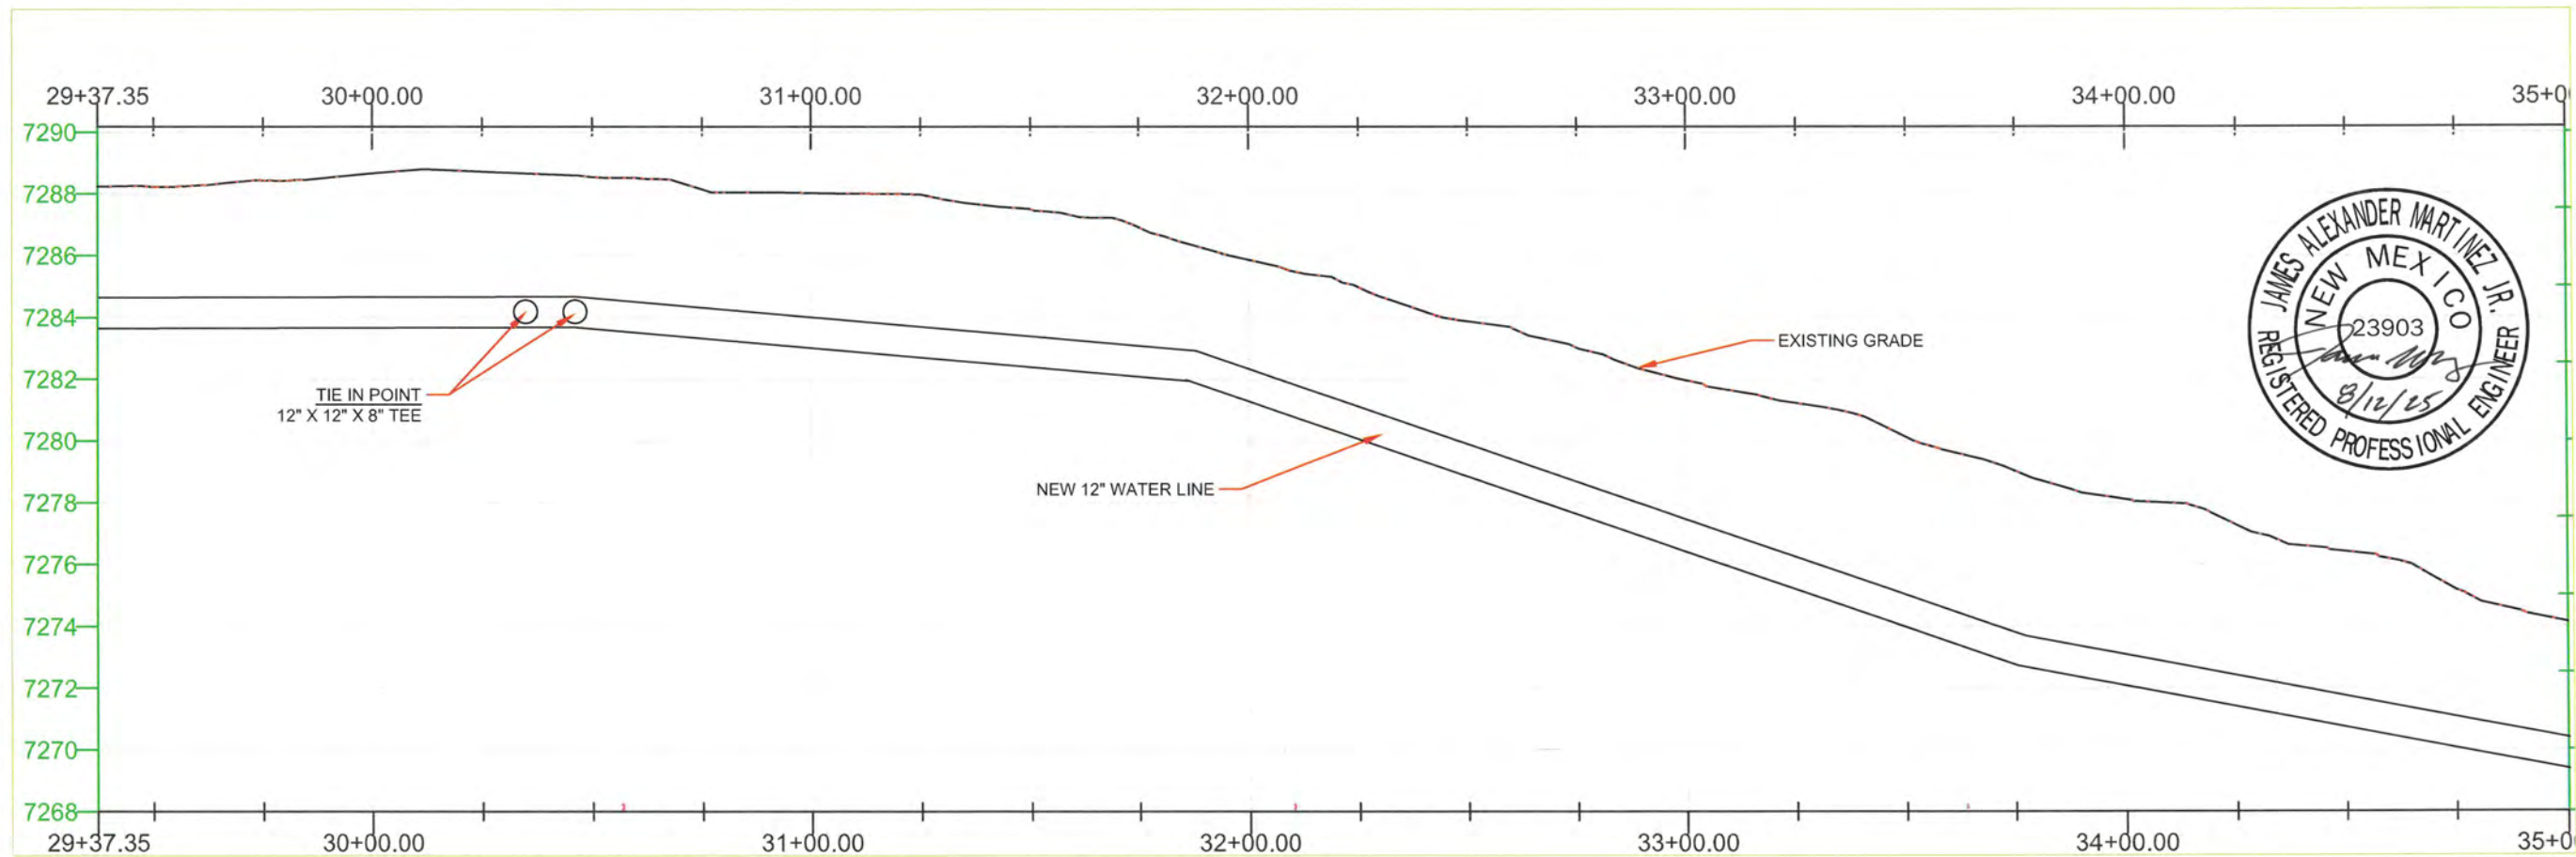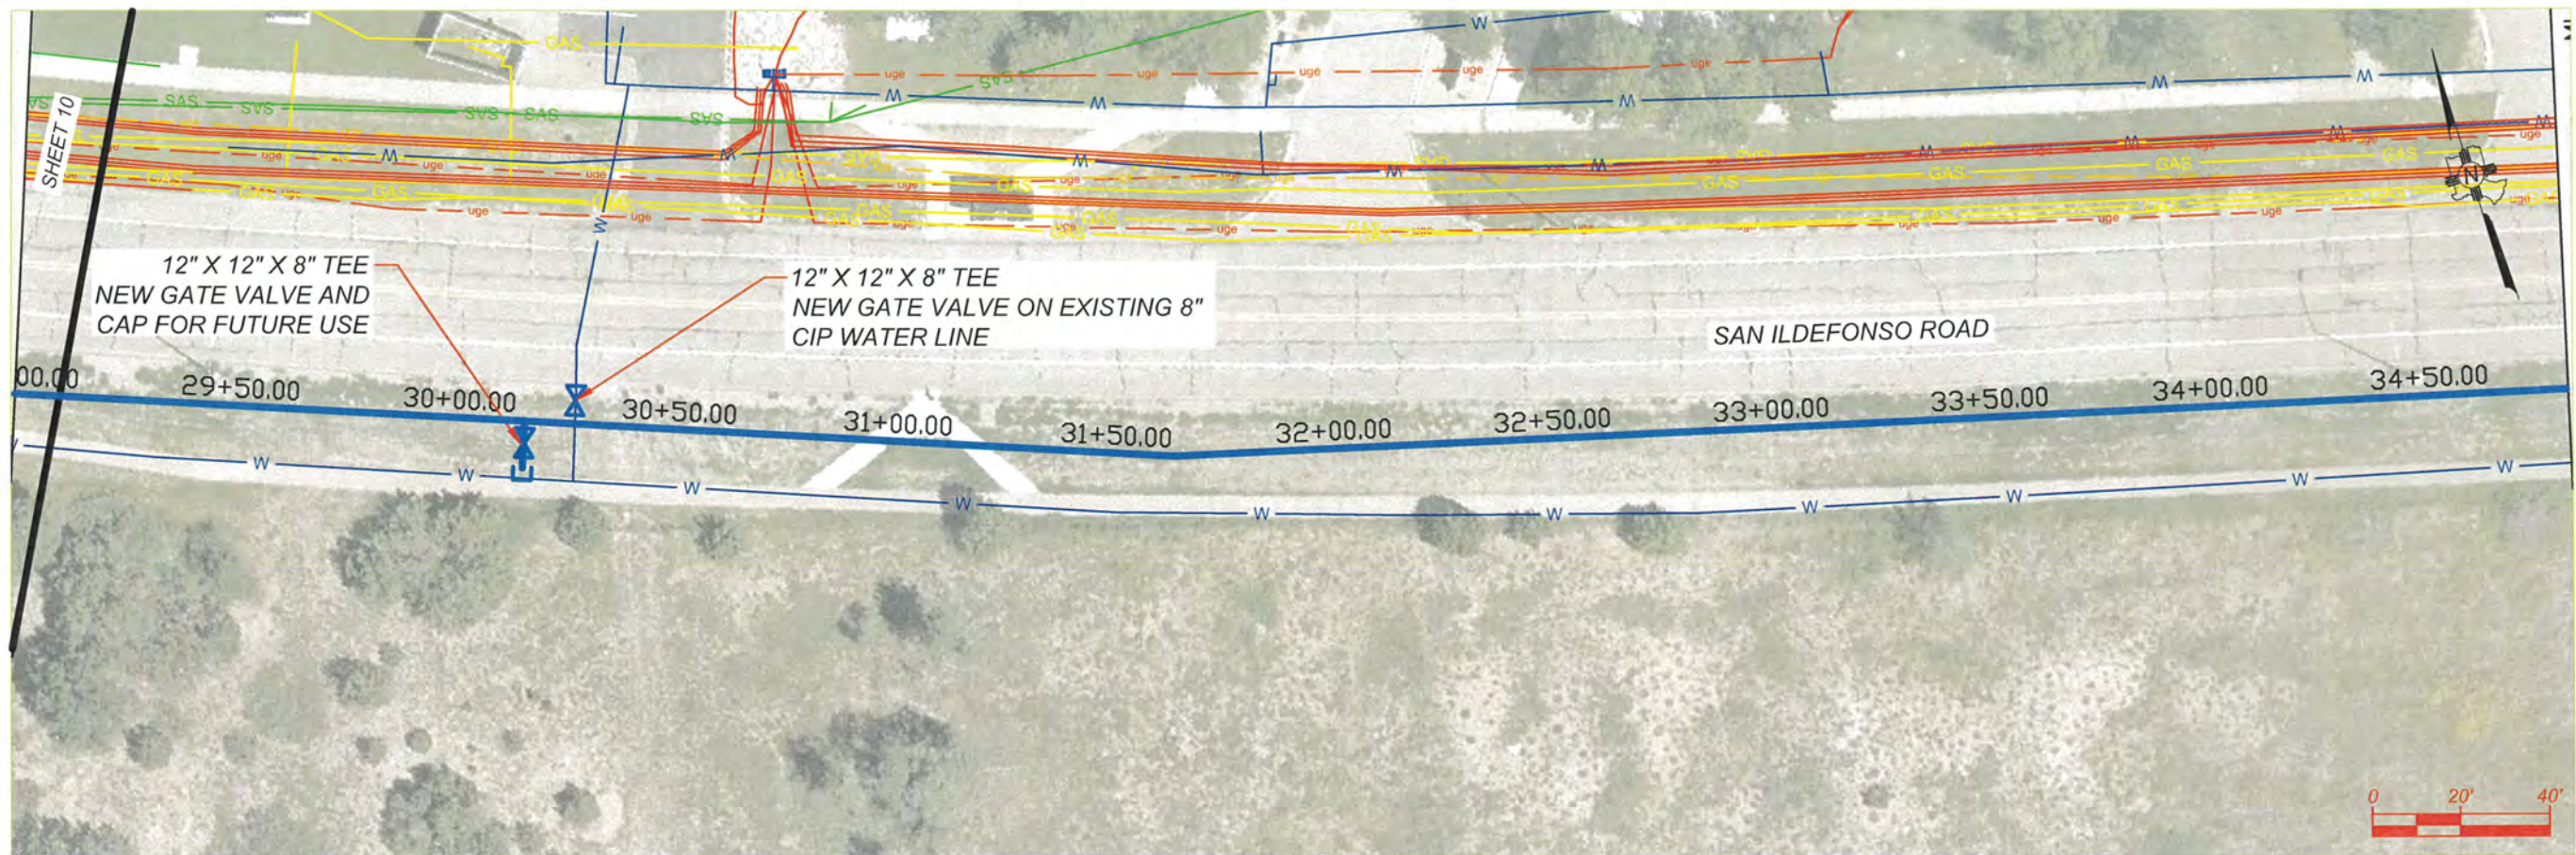

REVISION DESCRIPTION	
NO.	
1	
2	
3	
4	
5	

DESIGNED BY:	SH
DRAWN BY:	SH
APPROVED BY:	JM
DATE:	3/31/2025
SCALE:	1"=40'

SAN ILDEFONSO ROAD
8" WATERLINE REPLACEMENT
12" WATERLINE ALIGNMENT





INCORPORATED COUNTY
OF LOS ALAMOS
PUBLIC WORKS DEPARTMENT
1000 CENTRAL AVE., SUITE 160
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109

SHEET
11

Drawing File: L:\PROJECTS\IFB 2025-XX SAN ILDEFONSO WATER LINE\03 DESIGN\CAD_DWG\SH40 SCALE SHEETS\SHEET 11.DWG

Drawing File: L:\PROJECTS\IFB 2025\XX SAN ILDEFONSO WATER LINE\03 DESIGN\CAD_DWG\540 SCALE SHEETS\12.DWG

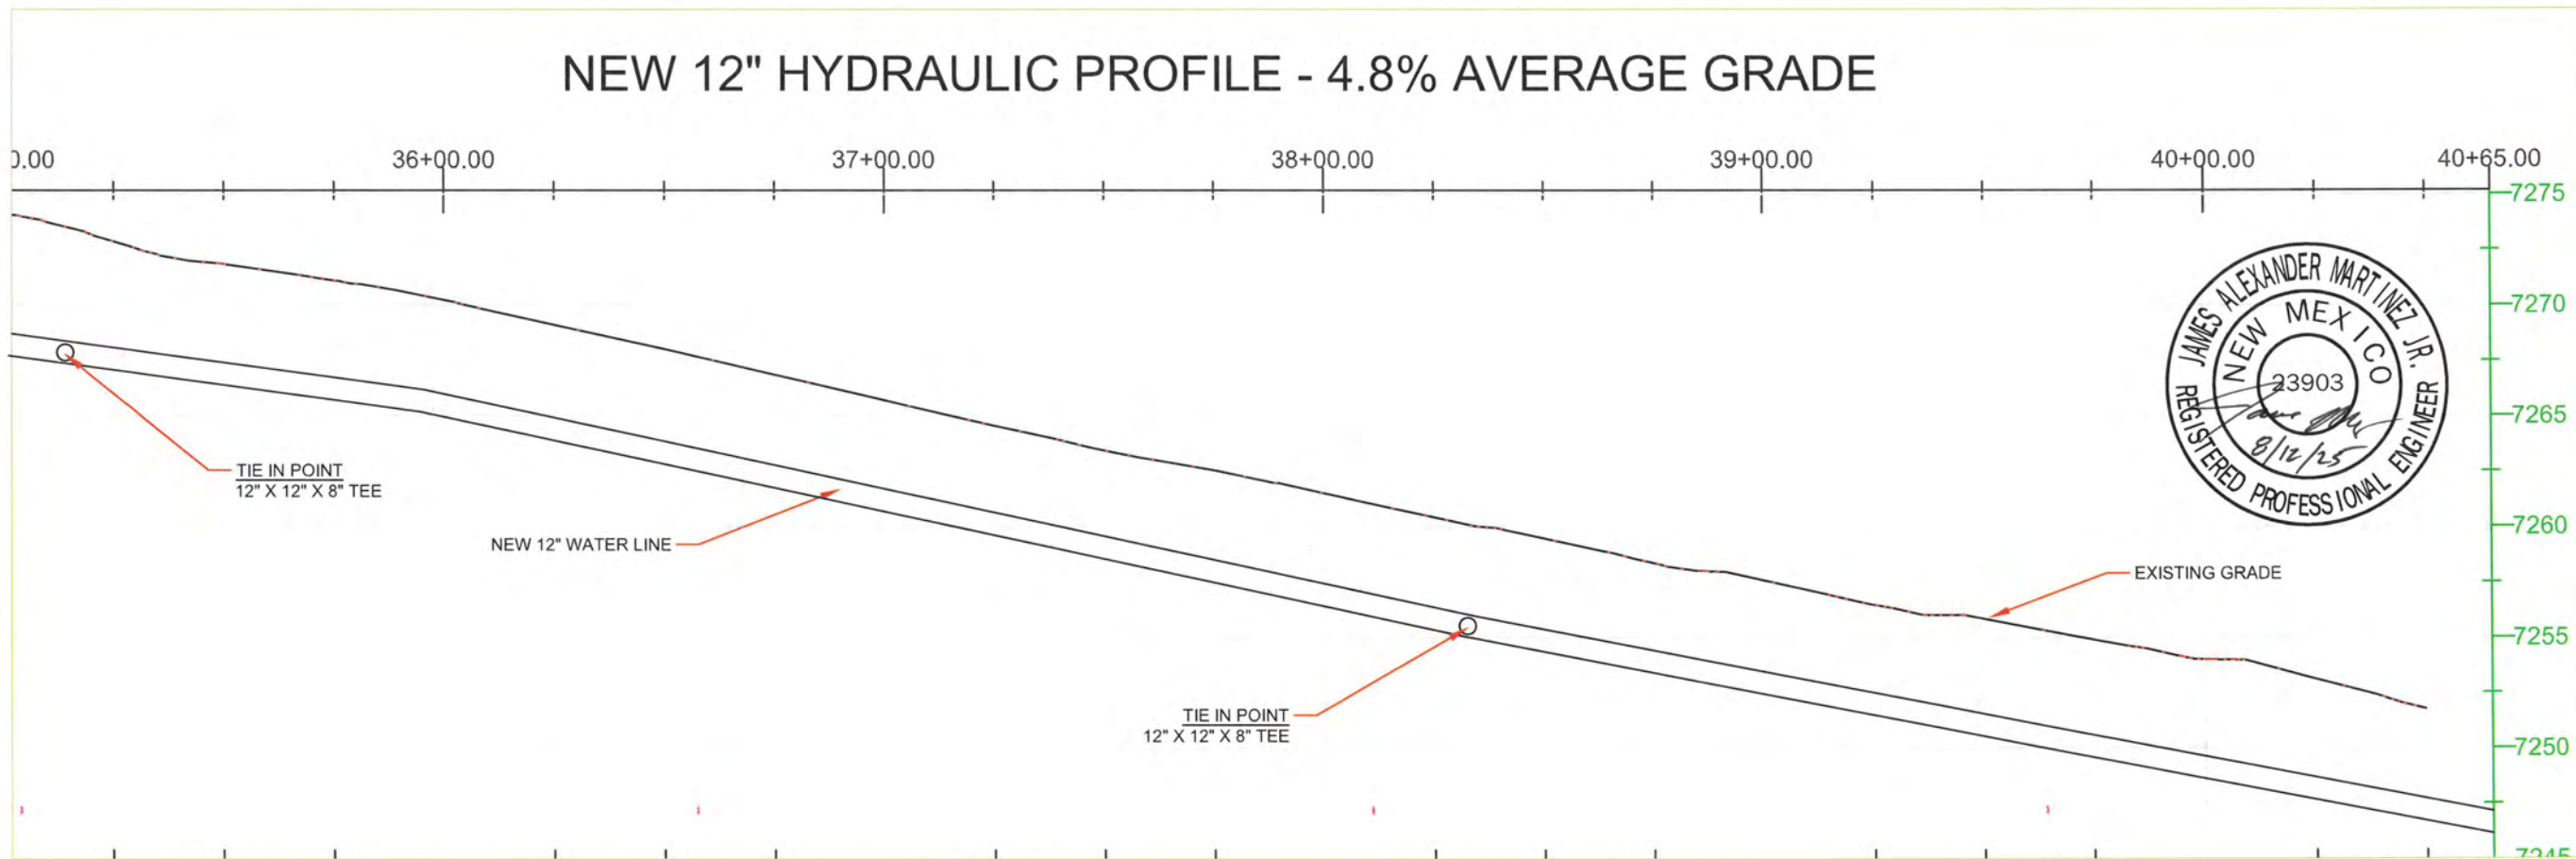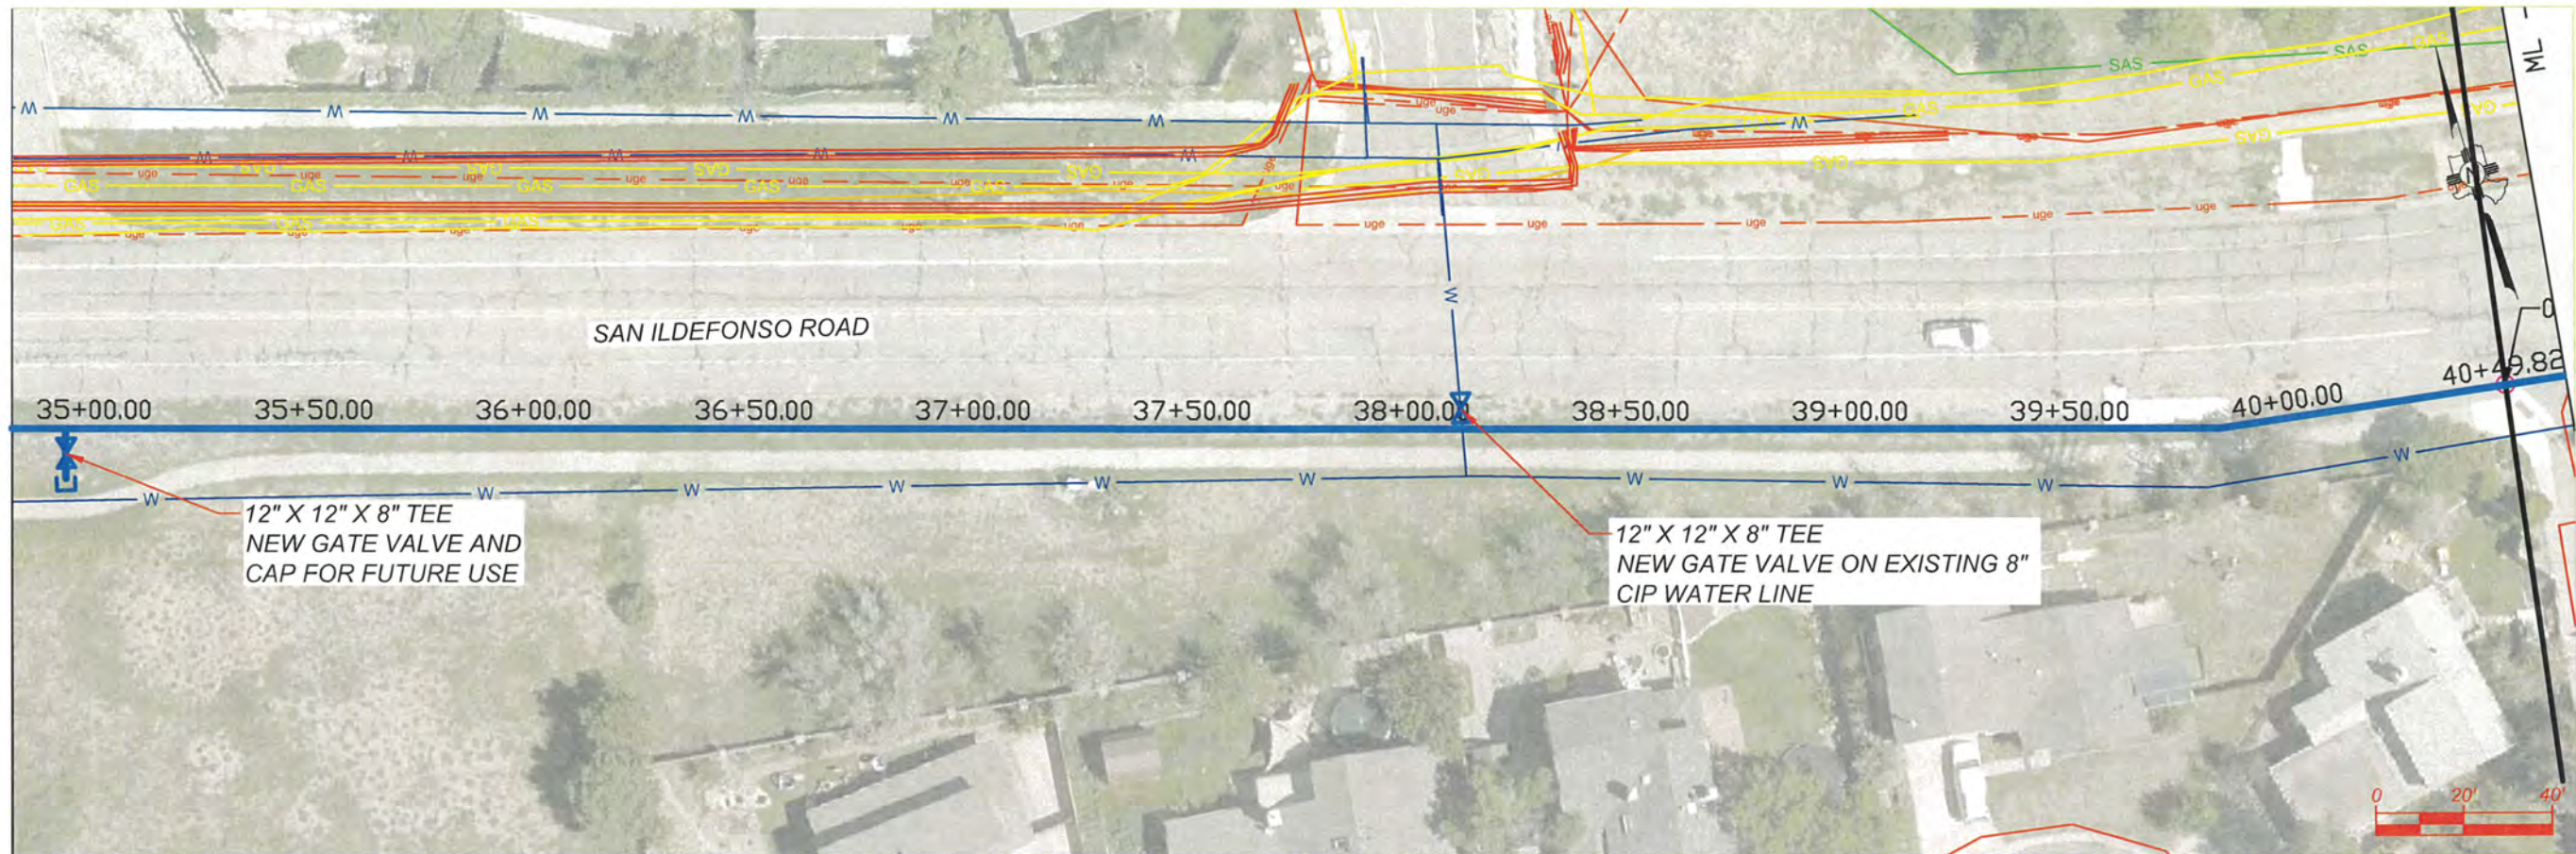

REVISION DESCRIPTION	
NO.	
1	
2	
3	
4	
5	



DESIGNED BY:	SH
DRAWN BY:	SH
APPROVED BY:	JM
DATE:	3/31/2025
SCALE:	1"=40'

SAN ILDEFONSO ROAD
8" WATERLINE REPLACEMENT
12" WATERLINE ALIGNMENT



INCORPORATED COUNTY
OF LOS ALAMOS
PUBLIC WORKS DEPARTMENT
1000 CENTRAL AVE., SUITE 160
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109

SHEET
12

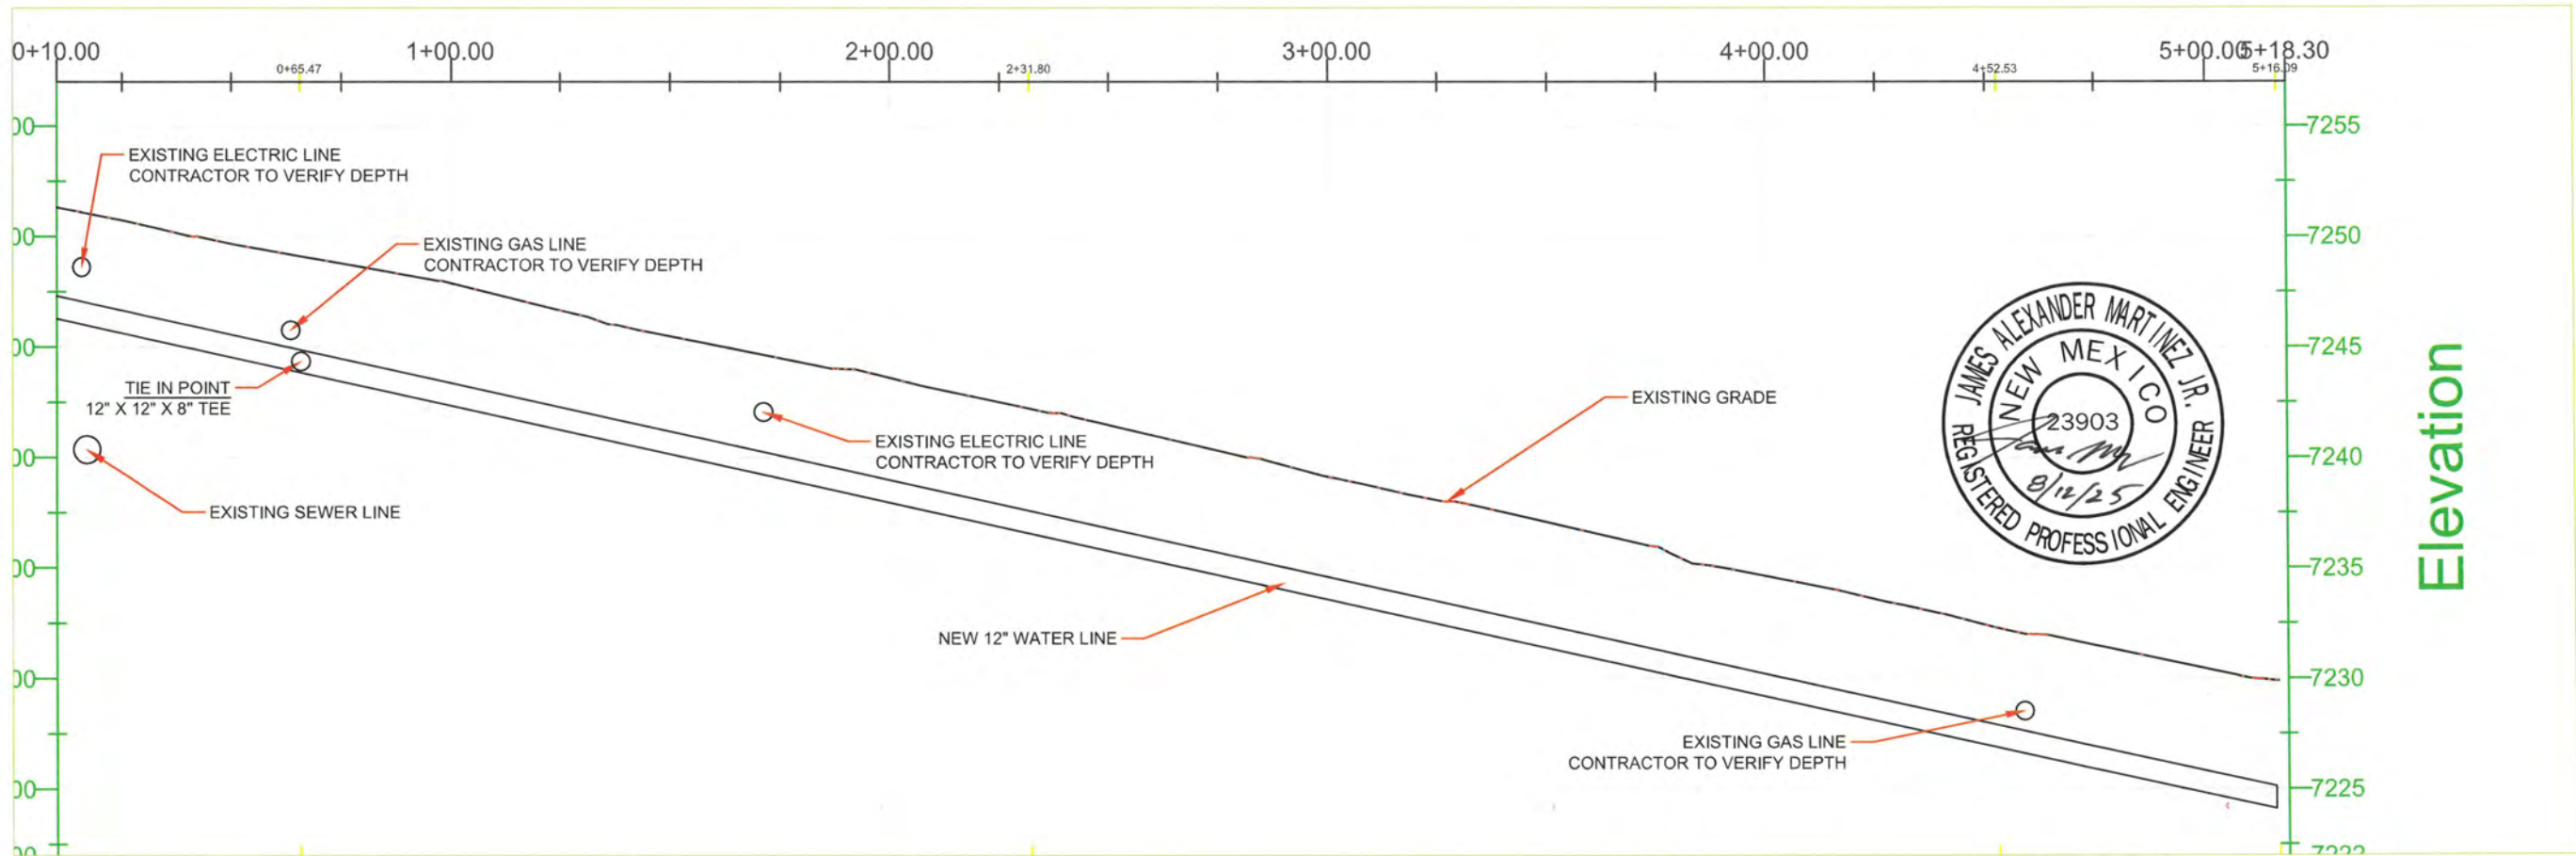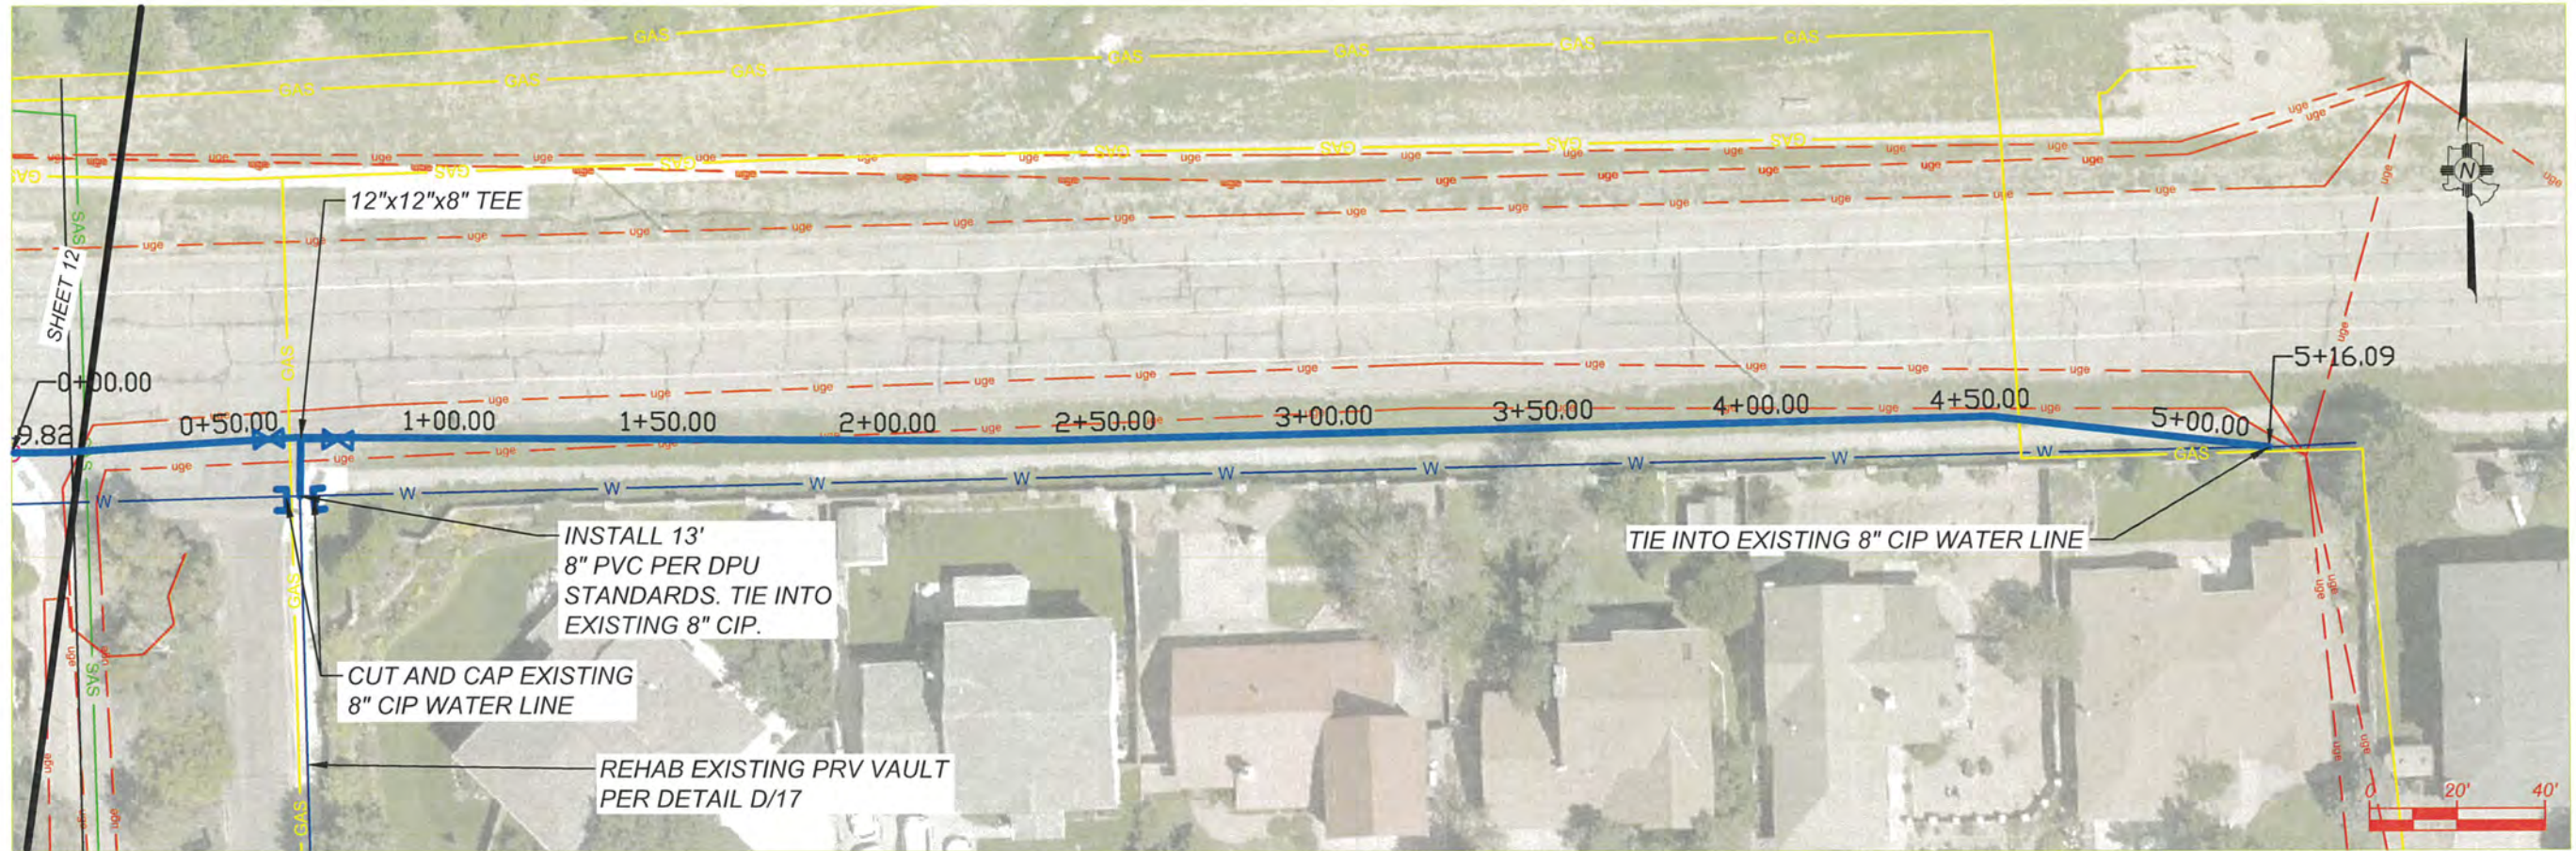

REVISION DESCRIPTION	
NO.	
1	
2	
3	
4	
5	

DESIGNED BY:	SH
DRAWN BY:	SH
APPROVED BY:	JM
DATE:	3/31/2025
SCALE:	1"=40'

SAN ILDEFONSO ROAD	
8" WATERLINE REPLACEMENT	
12" WATERLINE ALIGNMENT	




INCORPORATED COUNTY
OF LOS ALAMOS
PUBLIC WORKS DEPARTMENT
1000 CENTRAL AVE., SUITE 160
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109


SHEET
13

Drawing File: L:\PROJECTS\IFB 2025-XX SAN ILDEFONSO WATER LINE\03 DESIGN\CAD DWG\SHEET 13_USE.DWG


Drawing File: L:\PROJECTS\IFB 2025-XX SAN ILDEFONSO WATER LINE\03 DESIGN\CAD_DWG\EXISTING UTILITIES.DWG

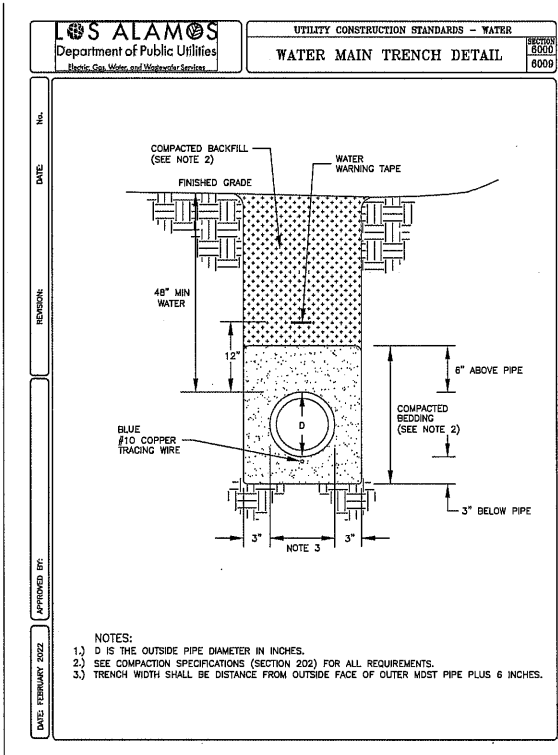


A
14
WATER MAIN TRENCH
SCALE: NTS

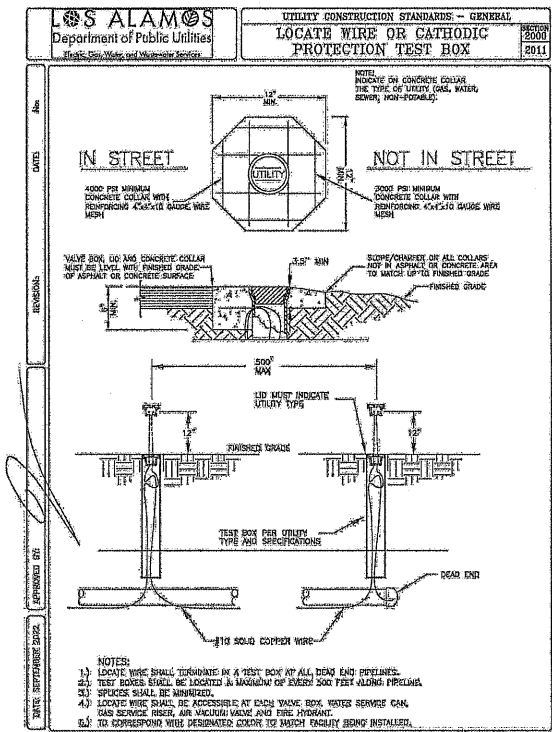

C
14
LOCATE WIRE TEST BOX
SCALE: NTS

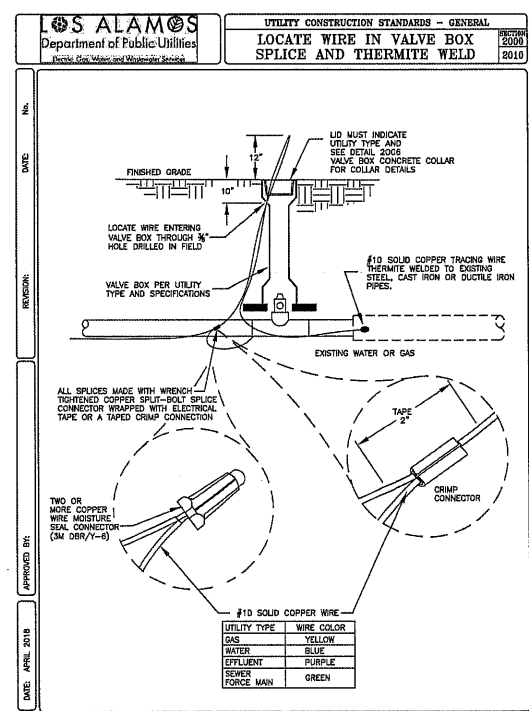

C
14
LOCATE WIRE IN VALVE BOX
SCALE: NTS

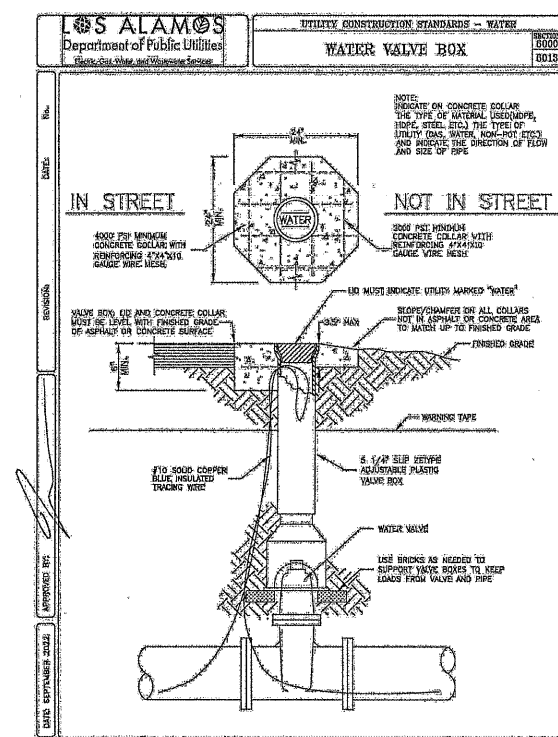

B
14
WATER VALVE BOX
SCALE: NTS



REVISION DESCRIPTION	
NO.	DESCRIPTION
1	
2	
3	
4	
5	

DESIGNED BY:	SH
DRAWN BY:	SH
APPROVED BY:	JAM
DATE:	10/24/2024
SCALE:	

SAN ILDEFONSO ROAD
8" WATERLINE REPLACEMENT

DETAILS-1

LOS ALAMOS

INCORPORATED COUNTY OF LOS ALAMOS
DEPARTMENT OF PUBLIC UTILITIES
1000 CENTRAL AVE., SUITE 130
LOS ALAMOS, NEW MEXICO 87544
(505) 682-8150 FAX: (505) 682-8109

SHEET
14

Drawing File: L:\PROJECTS\BIFB 2005-XX SAN ILDEFONSO WATER LINE\03 DESIGN\CAD_DWG\EXISTING UTILITIES.DWG

No.

DATE:

REVISION:

APPROVED BY:

DATE: APRIL 2018


PVC Mechanical Joint Restraint Table

PIPE SIZE	BENDS				TEES			VERTICAL OFFSETS				DEAD ENDS & VALVES
	11 1/4	22 1/2	45	90	LRN = 5	LRN = 10	LRN = 20	45		22 1/2		
								DOWN	UP	DOWN	UP	
4"	2	4	7	18	15	1	1	16	4	8	2	39
6"	2	5	10	25	30	7	1	23	5	11	3	55
8"	3	7	14	33	48	24	1	30	7	15	3	73
10"	4	8	16	39	61	37	1	36	8	17	4	88
12"	5	9	19	46	76	52	5	43	10	21	5	104

Ductile Iron/Poly Wrap Mechanical Joint Restraint Table

PIPE SIZE	BENDS				TEES			VERTICAL OFFSETS				DEAD ENDS & VALVES
	11 1/4	22 1/2	45	90	LRN= 5	LRN= 10	LRN= 18	45		22 1/2		
								DOWN BEND	UP BEND	DOWN BEND	UP BEND	
4"	2	4	9	21	23	1	1	24	4	12	2	59
6"	3	6	12	29	47	10	1	34	6	17	3	83
8"	4	8	16	38	74	37	1	45	8	22	4	109
10"	5	9	19	46	94	57	1	54	10	26	5	131
12"	5	11	22	54	118	80	20	64	12	31	6	155
14"	6	12	25	61	139	101	41	73	14	35	7	177
16"	7	14	29	69	162	124	63	83	15	40	7	200
18"	7	15	32	76	183	145	84	92	17	44	8	222


1. Restrained lengths provided are in feet.
2. Lr - the minimum attached length of solid pipe without joints, fittings, etc. to extend in each direction along the run of the tee.
3. Restrained lengths computed for pipe with 4' of cover from top of pipe.
4. Maximum test pressure of 150 psi.
5. All pipe joints and fittings within the restrained length specified in the table shall be restrained.

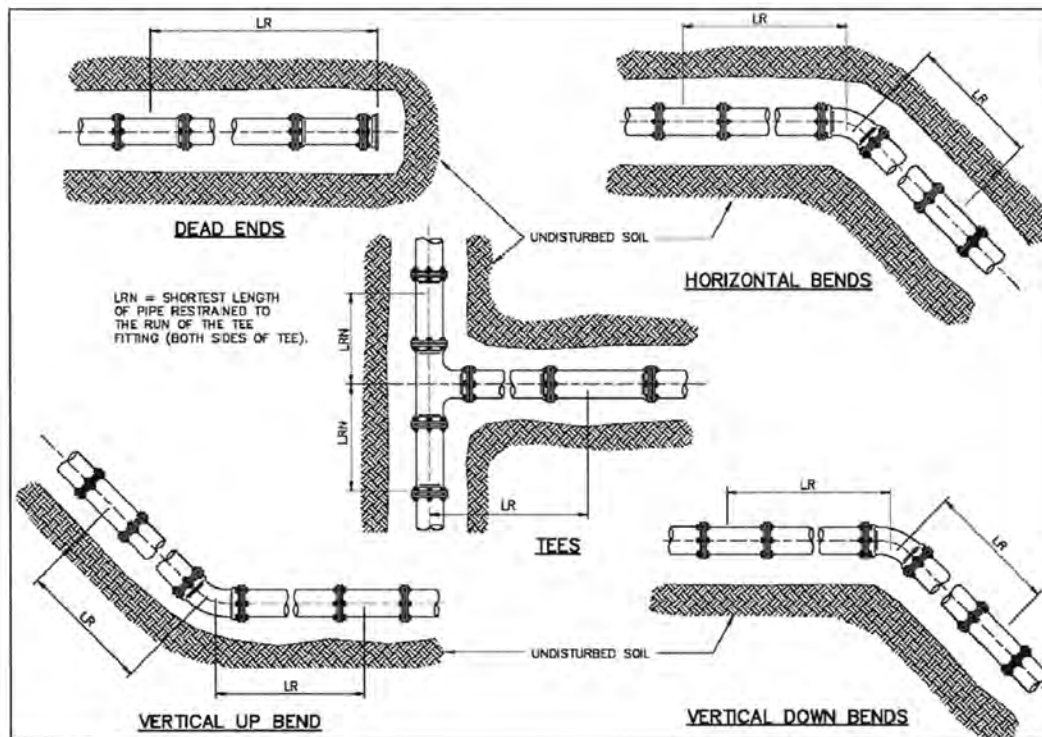

A
15

JOINT RESTRAINTS


SCALE: NTS

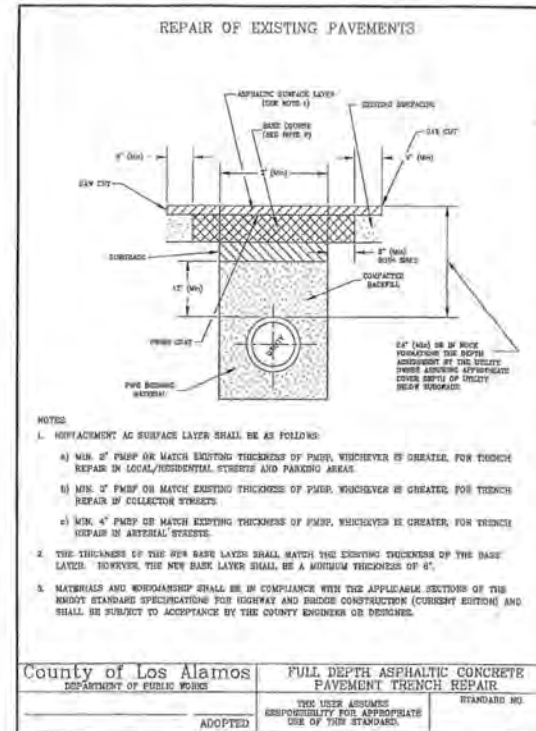

B
15

PAVEMENT REPAIR

SCALE: NTS

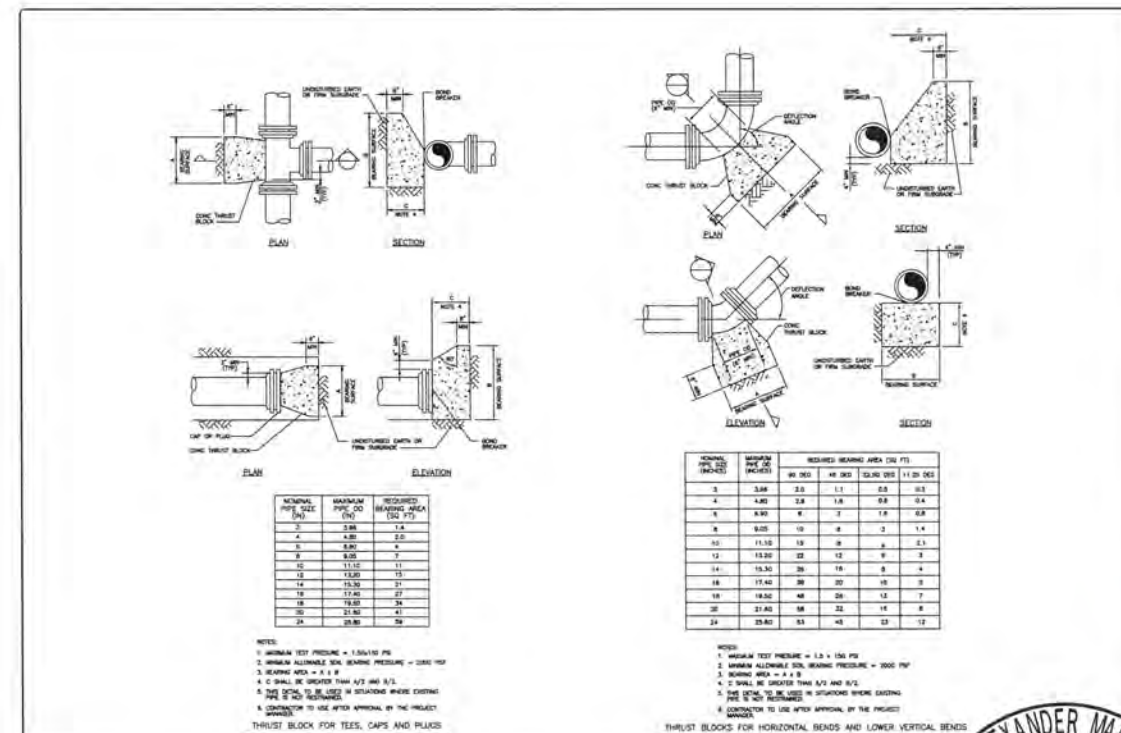

DATE: APRIL 2018


APPROVED BY:

REVISION:

C
15

CONCRETE THRUST-BLOCKS

SCALE: NTS



UTILITY CONSTRUCTION STANDARDS - WATER
SECTION
6000
6015
CONCRETE BLOCKING

LOS ALAMOS
Department of Public Utilities
Electric, Gas, Water and Wastewater Services

INCORPORATED COUNTY
OF LOS ALAMOS
DEPARTMENT OF PUBLIC UTILITIES
1000 CENTRAL AVE., SUITE 150
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109

SAN ILDEFONSO ROAD
8" WATERLINE REPLACEMENT
DETAILS-2

LOS ALAMOS

REVISION DESCRIPTION	
NO.	
1	
2	
3	
4	
5	

DESIGNED BY: SH
DRAWN BY: SH
APPROVED BY: JAM
DATE: 10/24/2024
SCALE:


SHEET
15

Drawing File: L:\PROJECTS\17B 2025\KX SAN ILDEFONSO WATER LINE\DWG\EXISTING UTILITIES.DWG


NOTES:

- 1) RUNG STEPS SHALL BE INSTALLED AT 1' O.C. ALIGNED WITH 36" ACCESS COVER.
- 2) WALLS AND FLOOR SHALL BE 8" THICK, REINFORCED WITH #5 BARS AT 12" O.C.E.W., CENTERED.
- 3) MINIMUM COVER ON REINFORCING STEEL SHALL BE 2".
- 4) STEEL SHALL BE GRADE 60 DEFORMED BARS, CONCRETE SHALL BE 4000 PSI MINIMUM COMPRESSIVE STRENGTH, WITH 6% AIR ENTRAINMENT, AND 3/4" COARSE AGGREGATE. PER SPECIFICATION 701 CAST IN PLACE CONCRETE.
- 5) COVERS SHALL BE FURNISHED W/4 LIFTING HOOKS, EACH LOCATED 12" INSIDE FROM EACH CORNER. LIFTING HOOKS SHALL BE FACTORY FABRICATED STEEL, RECESSED TO BE FLUSH WITH SURFACE, & TIED TO VAULT COVER REBAR PER MANUFACTURE'S RECOMMENDATIONS. EACH HOOK SHALL HAVE A MINIMUM CAPACITY OF 3 TONS.
- 6) COVERS SHALL NOT BE BONDED TO VAULT WALLS, THEY SHALL BE SEPARATELY FORMED & PLACED ONTO VAULT WALLS. PRIOR TO PLACEMENT, APPLY ONE STRIP OF LOFLAND BLUE STOP WATER STOP MATERIAL TO SEAL COVER TO WALLS. COVER SHALL BE FLUSH W/FINISHED GRADE.
- 7) COVERS SHALL BE FURNISHED WITH 2" Ø STEEL VENT, W/180° ELBOW SET 4' ABOVE TOP. PROVIDE STAINLESS STEEL GRATING OVER END SECTION, AND PAINT W/2 COATS OF GREY MARINE PAINT, EXTEND OUTSIDE OF ROADWAY IF NECESSARY.
- 8) INCOMING SYSTEM PRESSURES ARE SIGNIFICANTLY HIGHER THAN SERVICE PRESSURES. PRIOR TO PRESSURIZING THE NEW SYSTEM, THE CONTRACTOR SHALL CONTACT LAC UTILITIES TO ESTABLISH A TESTING PLAN WHICH WILL ENSURE NO DAMAGE TO DOWNSTREAM CUSTOMERS' PLUMBING.
- 9) HEAVY DUTY RING AND COVER CAST INTO VAULT LID. 475 LB. MINIMUM, 3' CLEAR OPENING, LABELED "WATER".
- 10) SUBGRADE BELOW VAULT FLOOR SHALL BE COMPACTED TO 95% PER SPECIFICATIONS.
- 11) LOCATE WIRE SHALL BE PLACED ALONG BY-PASS AND RAISED IN BY-PASS VALVE BOX AND THROUGH VAULT ALONG PIPING. ALL WIRE SHALL BE ELECTRICALLY CONTINUOUS.

NOTE: LID VENTED WITH A MINIMUM OF 12 EACH 1" DIAMETER HOLES.

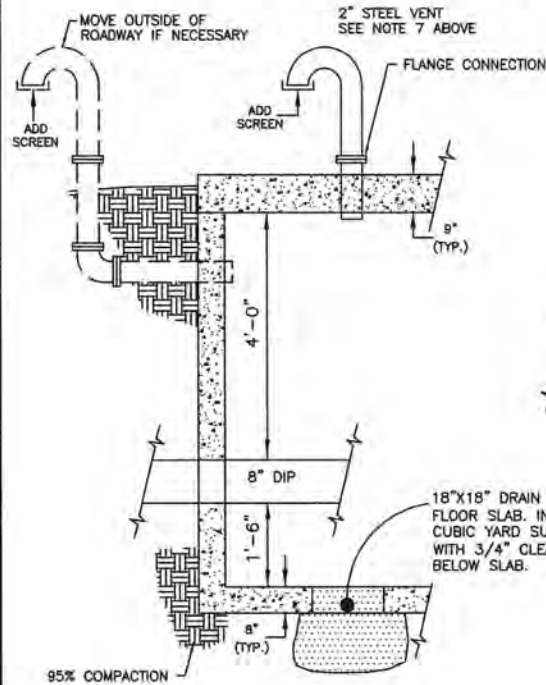


VALVE VAULT SECTION A-A
N.T.S.

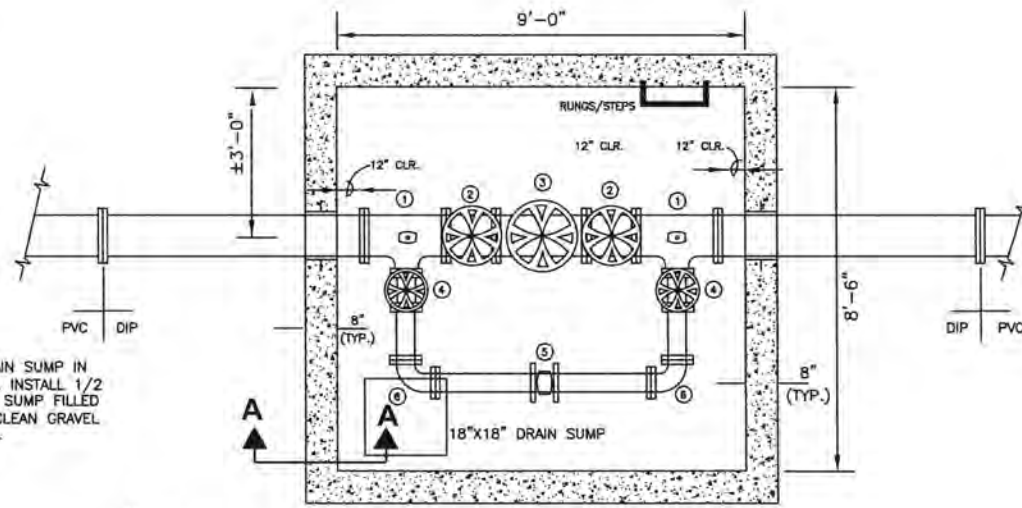


NOTE:
VALVE SIZES AND VAULT DIMENSIONS
CAN BE MODIFIED TO FIT PROJECT
REQUIREMENTS. DIMENSIONS SHOWN
ARE FOR AN 8'x4' PRV SET.

VALVE VAULT DETAILS PLAN
N.T.S.

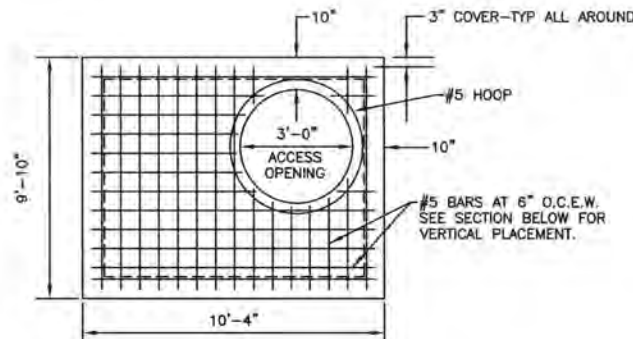


PLAN

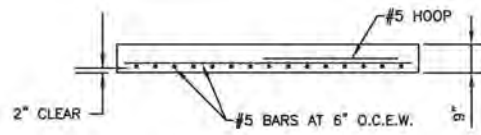

CROSS SECTION

PRV VAULT STRUCTURAL DETAILS
N.T.S.

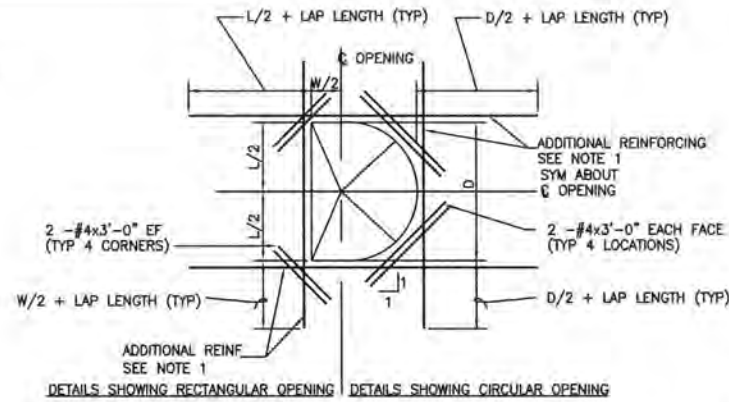

- NOTES:
1. ADDITIONAL REINFORCING SHALL BE THE SAME SIZE AS DISCONTINUOUS REINFORCEMENT AT OPENING. QUANTITY OF REINFORCING IN EACH DIRECTION SHALL BE EQUAL TO OR ONE GREATER THAN THE NUMBER OF DISCONTINUOUS BARS. PLACE 1/2 OF ADDITIONAL REINFORCING BARS EACH SIDE OF OPENING. PLACE ADDITIONAL REINFORCEMENT AT 3" O.C. (TYPICAL BOTH DIRECTIONS AND ALL LAYERS OF REINFORCEMENT).
 2. ADDITIONAL REINFORCING SHALL EXTEND BEYOND EDGE OF OPENING AS SHOWN ABOVE UNLESS SHOWN OTHERWISE. ADDITIONAL BARS MAY TERMINATE AT THE END OF THE WALL WITH A STANDARD HOOK WHERE THE LENGTH OF THE WALL WILL NOT PERMIT BARS TO EXTEND AS SHOWN ABOVE.
 3. TYPICAL WALL OR SLAB REINFORCING NOT SHOWN FOR CLARITY. TERMINATE TYPICAL REINFORCING 2" CLEAR TO OPENING.
 4. AT OPENINGS 12" OR LESS IN SLABS & IN WALLS, NO EXTRA REBARS ARE REQUIRED UNLESS SHOWN OTHERWISE. TYPICAL REINFORCING SHALL BE SPREAD (NOT CUT) TO ALLOW FOR OPENINGS TO BE MADE.
 5. UNLESS SHOWN OTHERWISE ON DRAWINGS, PROVIDE EXTRA REINFORCING AROUND OPENINGS AS SHOWN AND INDICATED ABOVE.
 6. ALL FASTENERS SHALL BE TORQUE RATED STAINLESS STEEL.

DETAIL EXTRA REBARS AROUND OPENINGS
AND PENETRATIONS IN SLABS & WALLS
N.T.S.

KEYED NOTES FOR 8" WATER MAIN:

- 1 8" x 8" x 4" FLANGED TEE.
- 2 8" GATE VALVE (FL X FL) VALVE.
- 3 8" PRV, CLA-VAL #690-01 OR 90-1 WITH KD VALVE STEM OPTION. PROVIDE SHOP FABRICATED STEEL SUPPORT.
- 4 4" GATE VALVE (FL X FL)
- 5 4" PRV, CLA-VAL #690-01 OR 90-1 WITH KD VALVE STEM OPTION. PROVIDE SHOP FABRICATED STEEL SUPPORT.
- 6 4" 90° STANDARD FLANGED ELBOW. PROVIDE PIPE SUPPORT.
- 7 WALL PENETRATIONS SHALL BE FURNISHED WITH STANDARD, FACTORY FABRICATED WALL SLEEVES WHICH ALLOW CARRIER PIPE TO BE INSERTED AFTER FORMING. SEAL CARRIER PIPE-TO-SLEEVE SPACING WITH LINK SEAL AND NON-SHRINK GROUT.
- 8 PRESSURE GAGES PER NOTE (2) BELOW. INSTALL 1/2 INCH STAINLESS STEEL ISOLATION BALL VALVE AND STAINLESS STEEL NIPPLES AS NEEDED.
- 9 ALL PIPING AND FITTINGS IN VAULT SHALL BE CLASS 350 FLANGED DUCTILE DUCTILE IRON PER AWWA C151 AND AWWA C110.
- 10 A COMBINATION MAIN LINE PRV WITH INTEGRAL LOW FLOW BYPASS VALVE MAY BE SUBSTITUTED, IF APPROVED BY DPU.

NOTES:

- 1 GATE VALVES INTERNAL TO THE VAULT SHALL BE HAND WHEEL OPERATED WITH NON-RISING STEMS.
- 2 PRESSURE GAGES SHALL BE ABLE TO REGISTER PRESSURES FROM 0 TO 150 PSI, AND HAVE GLYCERIN FILLED, FREEZE PROOF DIALS.
- 3 ALL PIPING AND VALVING SHALL BE SET SO THAT LARGEST DIAMETER PIPES IN STATIONS ARE SET 18" ABOVE FLOOR TO BOTTOM OF PIPE.

UTILITY CONSTRUCTION STANDARDS - WATER

SECTION 6000 6017
PRESSURE REDUCING VALVE VAULT

LOS ALAMOS
Department of Public Utilities
Electric, Gas, Water, and Wastewater Services

SAN ILDEFONSO ROAD
8" WATERLINE REPLACEMENT

DETAILS-3



LOS ALAMOS

INCORPORATED COUNTY
OF LOS ALAMOS
DEPARTMENT OF PUBLIC UTILITIES
1000 CENTRAL AVE., SUITE 130
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109

SHEET

16

DATE: APRIL 2018

APPROVED BY:

REVISION:

DATE:

No.

PRESSURE REDUCING VALVE VAULT

SCALE: NTS

Attachment B


Drawing File: L:\PROJECTS\WFB 2025-XX SAN ILDEFONSO WATER LINE\03 DESIGN\CAD DWGS\EXISTING UTILITIES.DWG



A
17 WEST END PRV VAULT
SCALE: NTS



B
17 REDONDO PRV VAULT
SCALE: NTS

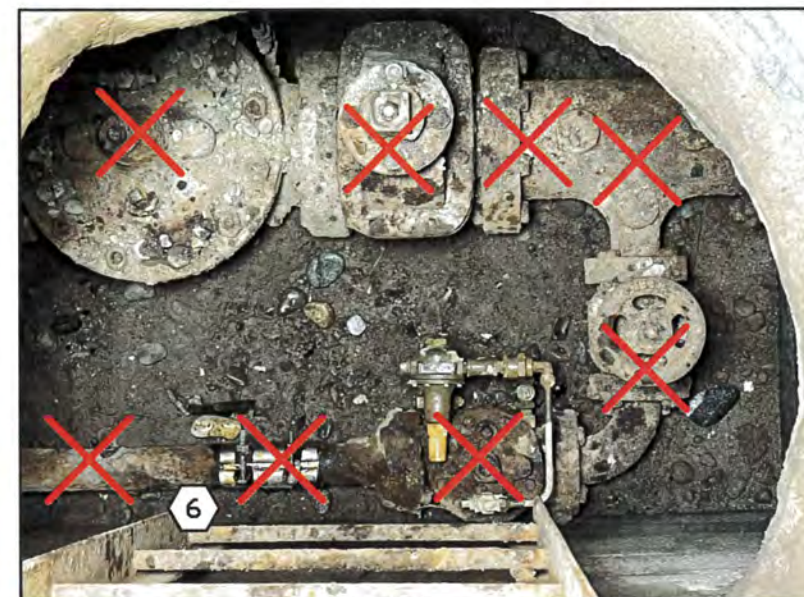


E
17 UVA PRV VAULT
SCALE: NTS

KEYED NOTES

- 1 REMOVE AND REPLACE VAULT COVER WITH 9" THICK CONCRETE SLAB AND 3' Ø MANHOLE, REINFORCED WITH #5 REBAR 6" O.C PER DETAIL A/17
- 2 INSTALL 2" STEEL VENT PER DETAIL A/17 NOTE #7
- 3 REMOVE AND REPLACE PRV'S, VALVES, AND APPURTENANCES WITH APPROVED EQUALS
- 4 PRESSURE WASH VAULT INTERIOR
- 5 ABANDON VAULT - REMOVE PRV AND COMPONENTS, INSTALL 4' OF 8" PVC, AND FILL WITH 5 YARDS OF APPROVED FILL MATERIAL
- 6 ABANDON VAULT - REMOVE PRV AND COMPONENTS, INSTALL 4' OF 8" PVC, AND FILL WITH 8 YARDS OF APPROVED FILL MATERIAL



C
17 BROADVIEW PRV VAULT
SCALE: NTS

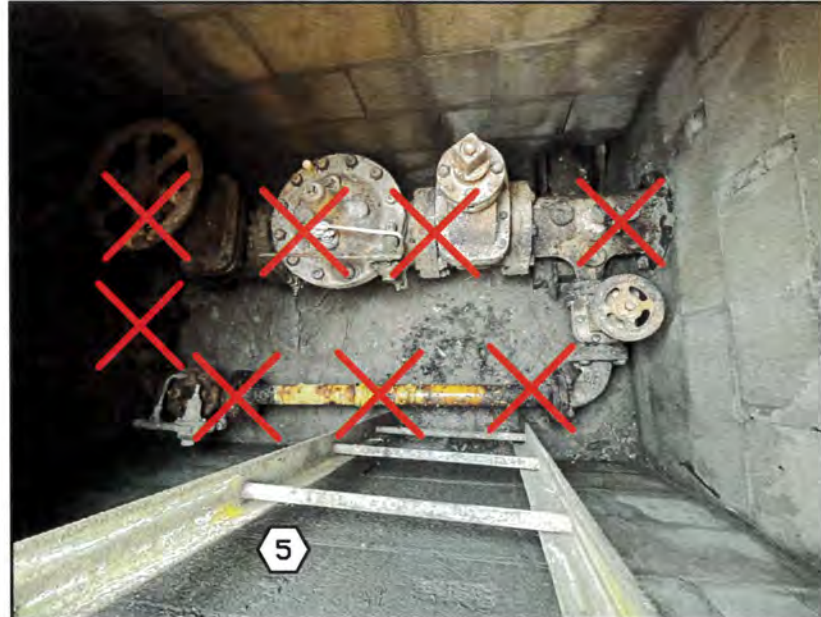

D
17 DURASNILLA PRV VAULT
SCALE: NTS

Attachment B

REVISION DESCRIPTION	
NO.	
1	
2	
3	
4	
5	

DESIGNED BY:	SH
DRAWN BY:	SH
APPROVED BY:	JAM
DATE:	10/24/2024
SCALE:	

SAN ILDEFONSO ROAD
8" WATERLINE REPLACEMENT
DETAILS-4



INCORPORATED COUNTY
OF LOS ALAMOS
DEPARTMENT OF PUBLIC UTILITIES
1000 CENTRAL AVE., SUITE 130
LOS ALAMOS, NEW MEXICO 87544
(505) 662-8150 FAX: (505) 662-8109

SHEET
17